




**GLAZING CALCULATIONS**  
 LIMITING DISTANCE: 40' 5" (12.3 M)  
 BUILDING FACE AREA: 1389.7 SQ.FT. (129.1 SQ.M.)  
 ALLOWABLE OPENINGS: 55%  
 PROPOSED OPENINGS: 178.3 SQ.FT. (12.8%)

-  HORIZONTAL VINYL SIDING
-  STONE
-  BRICK

4.0 T/O Wall  
357.34

PRE-FINISHED ALUMINUM  
GUTTER AT EAVE AND  
DOWNSPOUTS AS REQ'D.

3.0 Upper Level  
354.87

2.0 Main Level  
351.78

1.0 Lower Level  
348.69

0.5 Gar. Bk.

348.20  
Reg. Flood Plain

348.00

0.5 Gar. Fr.

347.80

00 T/O Footing

346.58

MAX. BACKFILL HEIGHT FOR LATERALLY SUPPORTED  
WALLS IS 7' 6" W/ 8" OR 10" FOUNDATION WALL (20MPa)

**1** Front Elevation  
3/16" = 1'-0"



Drawings are only valid for permits after they have been signed. They are only valid for the original address in the titleblock. Do not scale drawings.

**Design Loads Criteria**

**Floor Loads:**  
 Live Load = 40 P.S.F.  
 Dead Load = 12 P.S.F.  
 Total Floor Load = 52 P.S.F.  
**Roof Loads:**  
 Live Loads = 42 P.S.F. (snowload)  
 Dead Load = 15 P.S.F.  
 Total Roof Load = 57 P.S.F.

**CLIENT NAME:**

**Crescent Homes**  
Rockwood Block 1

**LOCATION:**

George St. E,  
Guelph/Eramosa, ON



JANSSEN DESIGN

116063 2nd Line SW,  
Melancthon, ON, L9V 2C5

Phone #: 519.925.0663

Fax #: 519.925.1371

Email: natasha@janssendesign.ca



THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE DESIGNER BEFORE PROCEEDING WITH THE WORK.

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION  
Paul Janssen BCIN 25681

REGISTRATION INFORMATION  
Firm Name: Janssen Design & Construction  
(Div. of JDC Custom Homes Inc.)  
BCIN 32079

**DRAWING TITLE:**

Front Elevation

**DATE:**  
JUNE 21, 2021

**REVISIONS**

**DRAWN BY:**  
NJ

**CHECKED BY:**  
PJ

**PROJECT NO:**  
1905-1023

**A101**

Drawings are only valid for permits after they have been signed. They are only valid for the original address in the titleblock. Do not scale drawings.

**Design Loads Criteria**

**Floor Loads:**  
 Live Load = 40 P.S.F.  
 Dead Load = 12 P.S.F.  
 Total Floor Load = 52 P.S.F.  
**Roof Loads:**  
 Live Loads = 42 P.S.F. (snowload)  
 Dead Load = 15 P.S.F.  
 Total Roof Load = 57 P.S.F.

**CLIENT NAME:**

**Crescent Homes**  
 Rockwood Block 1

**LOCATION:**

George St. E,  
 Guelph/Eramosa, ON



JANSSEN DESIGN

116063 2nd Line SW,  
 Melancthon, ON, L9V 2C5

Phone #: 519.925.0663

Fax #: 519.925.1371

Email: natasha@janssendesign.ca



THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE DESIGNER BEFORE PROCEEDING WITH THE WORK.

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

**QUALIFICATION INFORMATION**  
 Paul Janssen BCIN 25681

**REGISTRATION INFORMATION**  
 Firm Name: Janssen Design & Construction  
 (Div. of JDC Custom Homes Inc.)  
 BCIN 32079

**DRAWING TITLE:**

**Rear Elevation**

**DATE:**  
 JUNE 21, 2021

**REVISIONS**

**DRAWN BY:**  
 NJ

**CHECKED BY:**  
 PJ

**PROJECT NO:**  
 1905-1023

**A102**

# Rear Elevation


3/16" = 1'-0"

1

**GLAZING CALCULATIONS**  
 LIMITING DISTANCE: 34' 8 1/2" (10.6 M.)  
 BUILDING FACE AREA: 952.8 SQ.FT (88.5 SQ.M.)  
 ALLOWABLE OPENINGS: 84%  
 PROPOSED OPENINGS: 123.6 SQ.FT (13.0%)

- HORIZONTAL VINYL SIDING
- STONE
- BRICK

- 4.0 T/O Wall  
357.34
- 3.0 Upper Level  
354.87
- 2.0 Main Level  
351.78
- 1.0 Lower Level  
348.69
- 0.5 Gar. Bk.  
348.20
- Reg. Flood Plain  
348.00
- 0.5 Gar. Fr.  
347.80

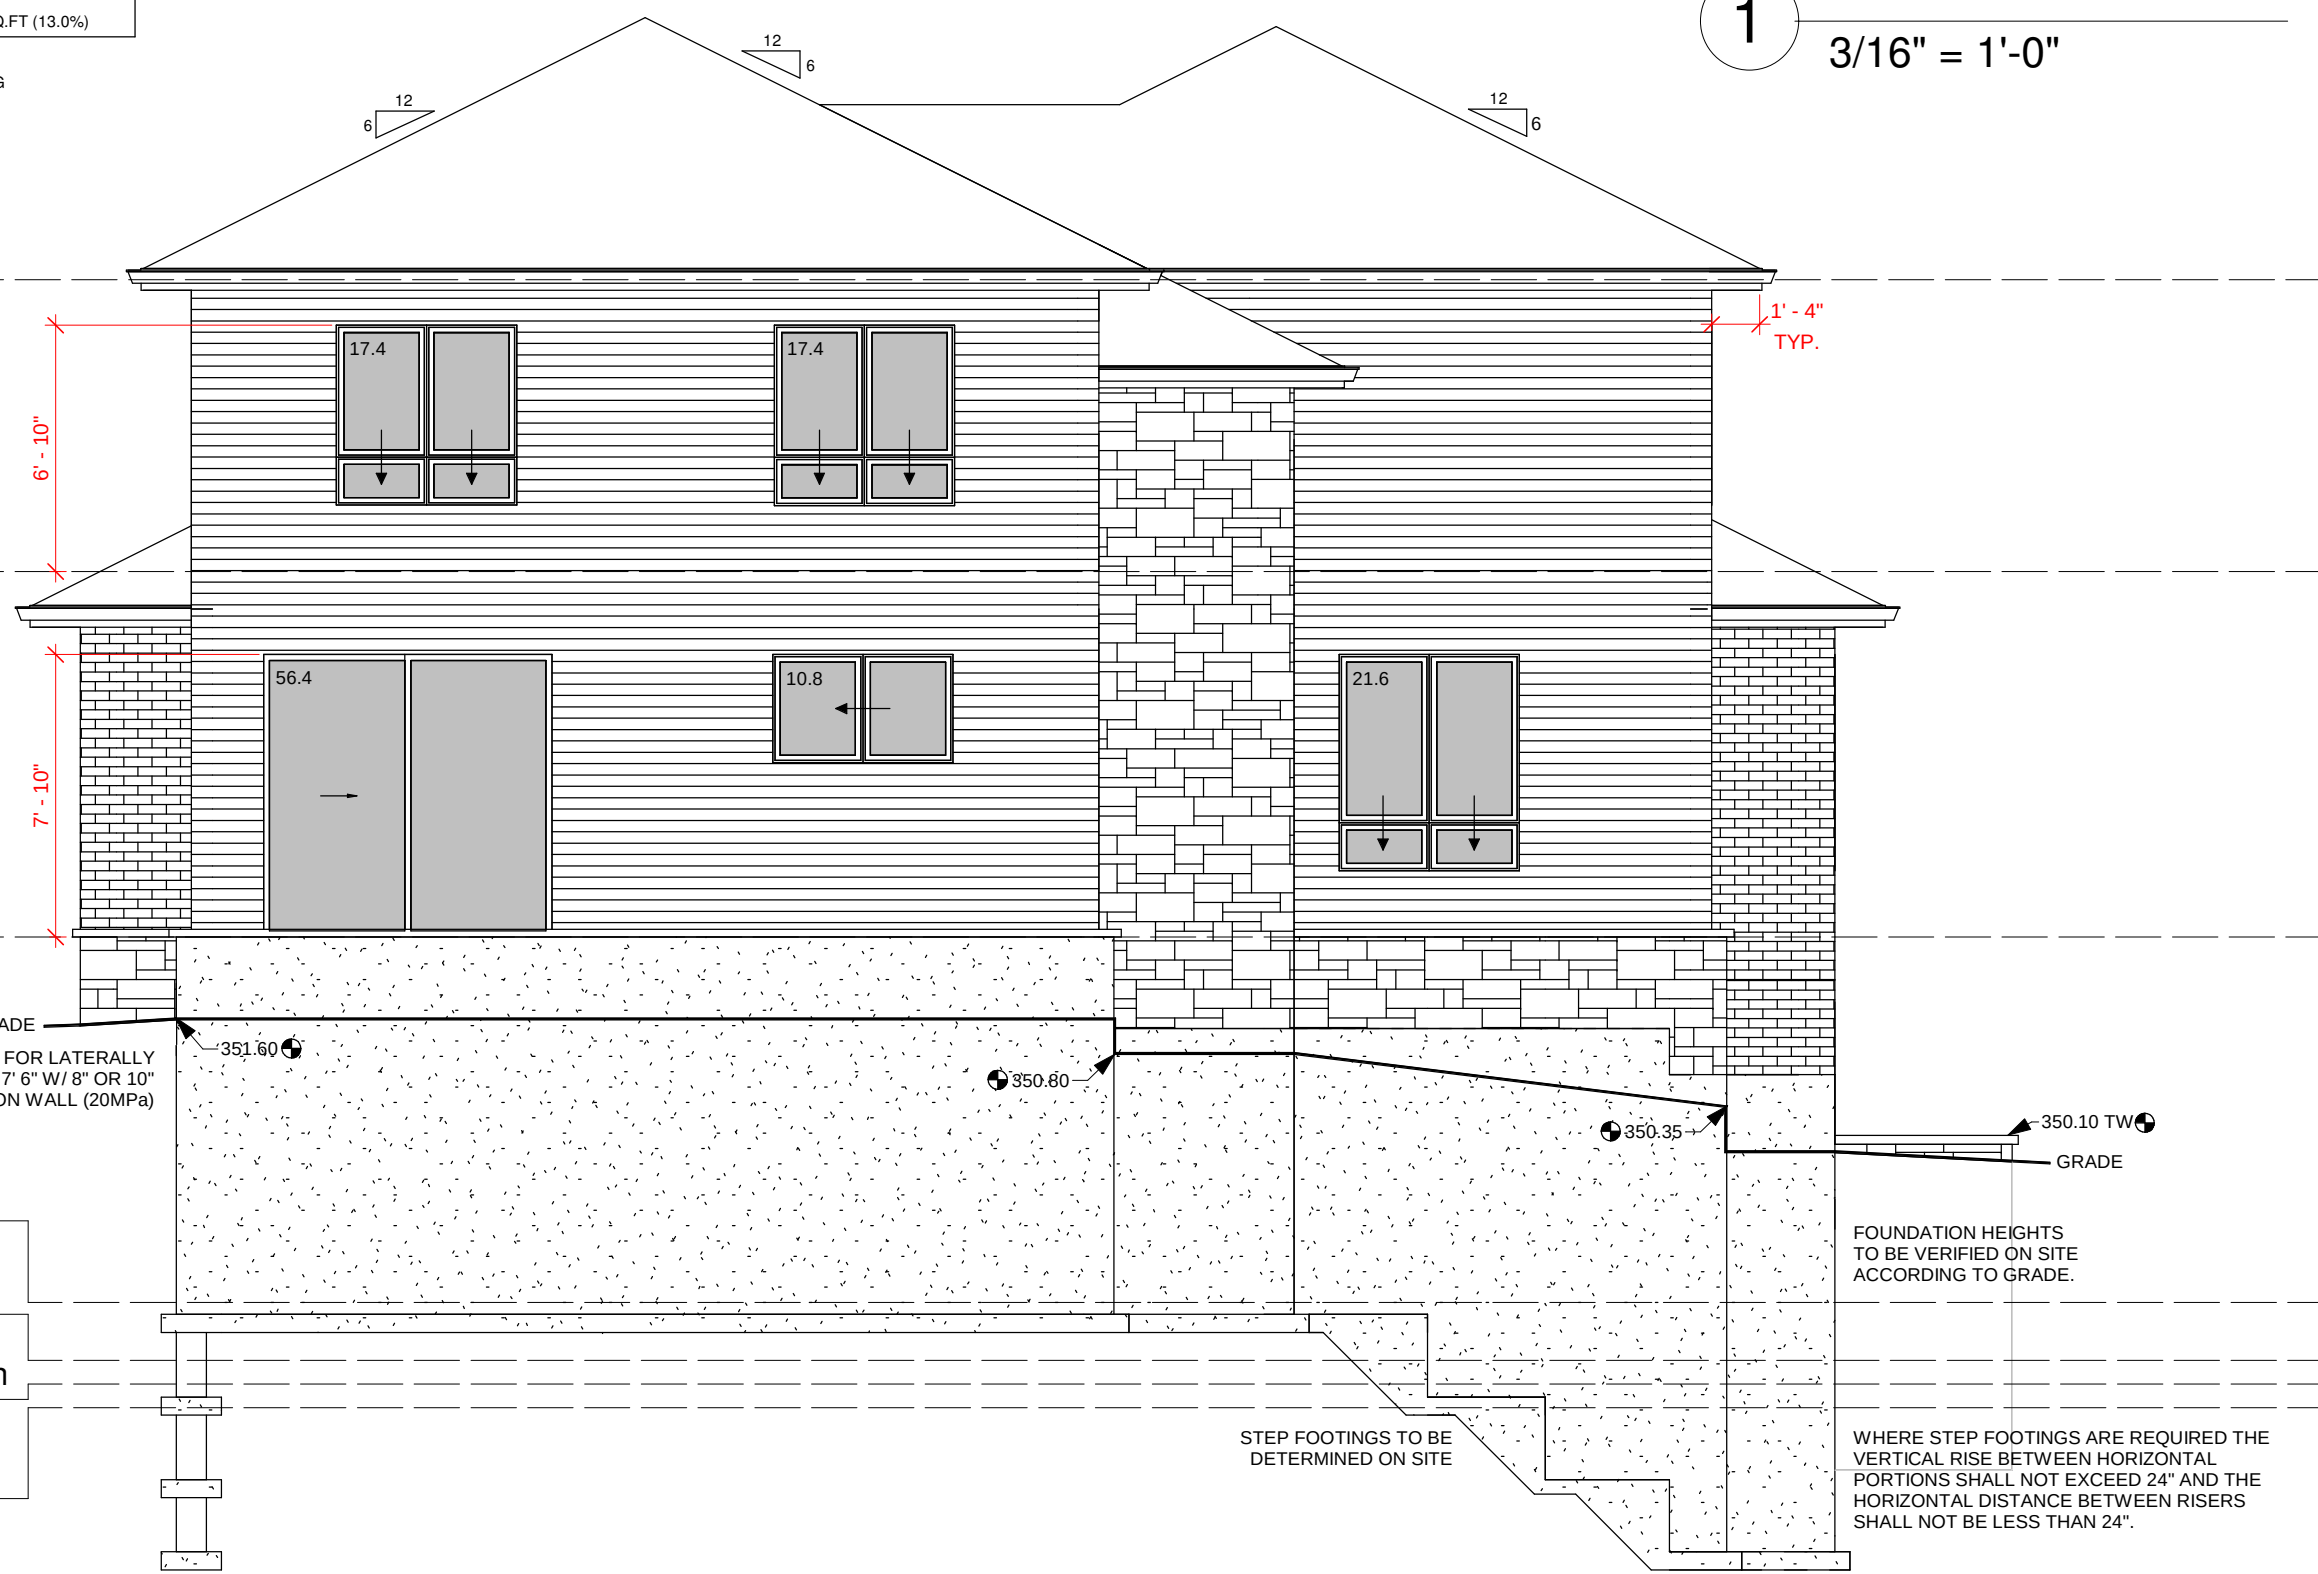

2021-06-21 6:04:50 PM

| GLAZING CALCULATIONS                           |
|--|
| LIMITING DISTANCE: 23' 7 1/2" (7.2 M.)         |
| BUILDING FACE AREA: 1110.7 SQ.FT. (83.5 SQ.M.) |
| ALLOWABLE OPENINGS: 34%                        |
| PROPOSED OPENINGS: 29.9 SQ. FT. (3.3%)         |

-  HORIZONTAL VINYL SIDING
-  STONE
-  BRICK

4.0 T/O Wall  
357.34

3.0 Upper Level  
354.87

2.0 Main Level  
351.78


1.0 Lower Level  
348.69

0.5 Gar. Bk.  
348.20

Reg. Flood Plain  
348.00

0.5 Gar. Fr.  
347.80

00 T/O Footing  
346.58

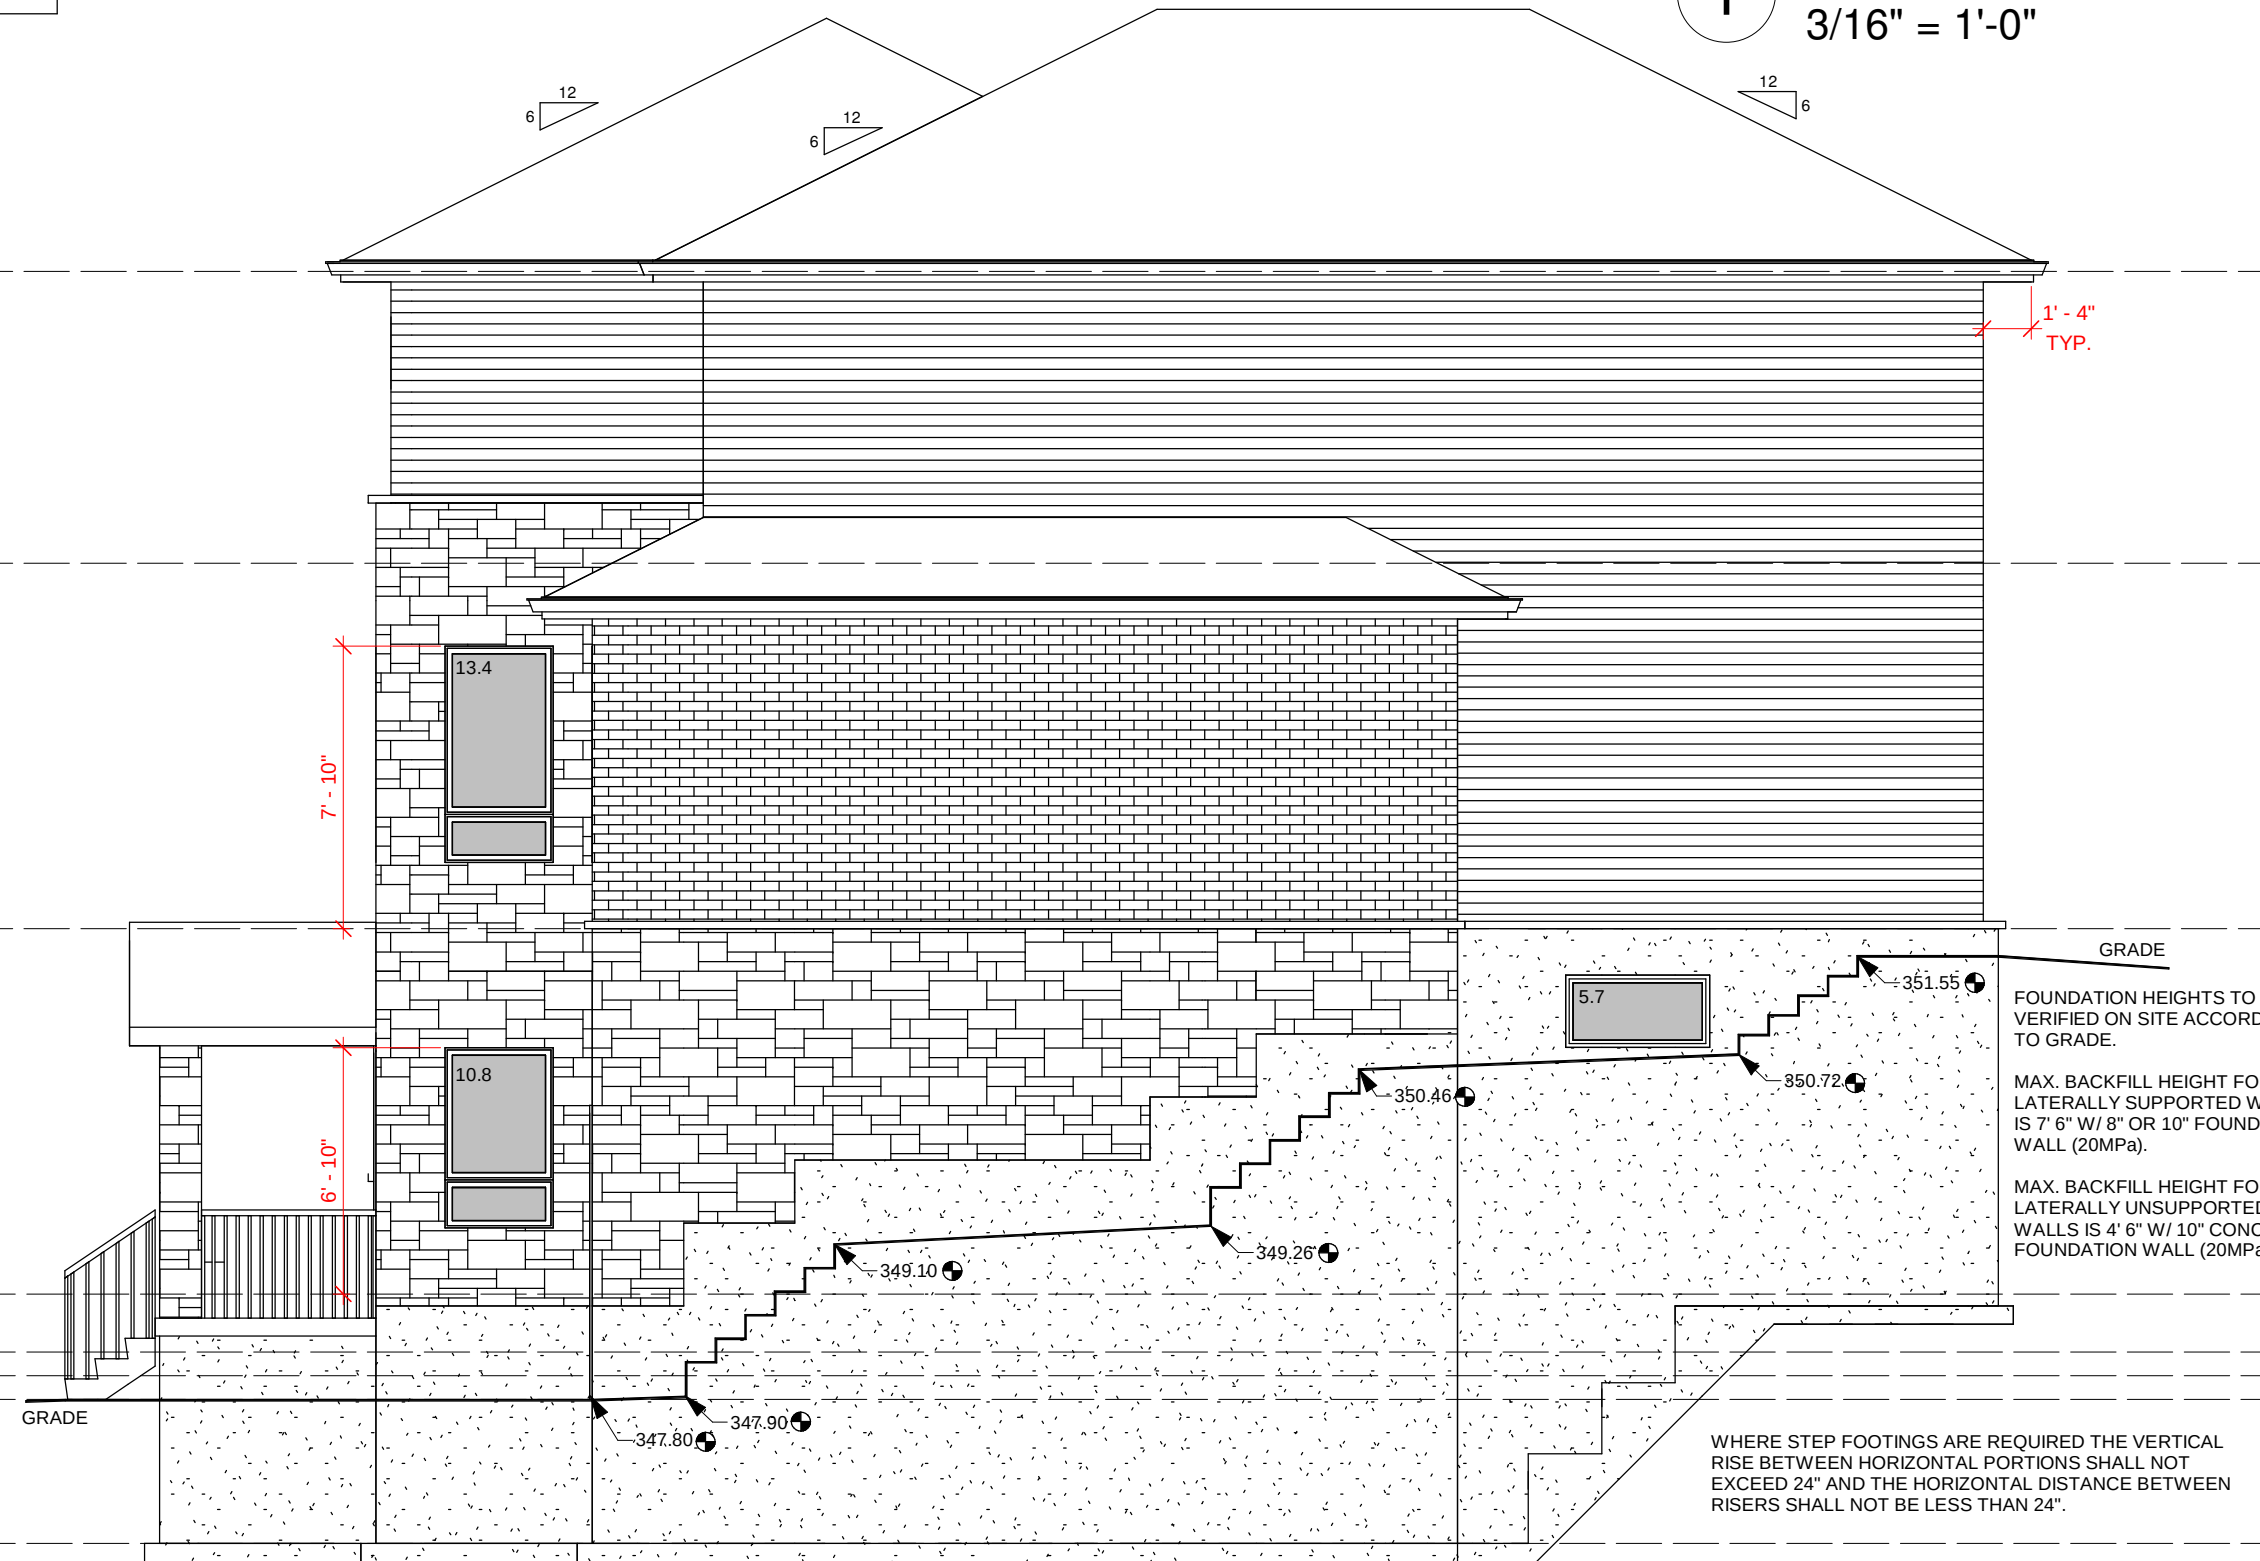

1

# Right Elevation

3/16" = 1'-0"

1'-4"  
TYP.

Drawings are only valid for permits after they have been signed. They are only valid for the original address in the titleblock. Do not scale drawings.

**Design Loads Criteria**

**Floor Loads:**  
 Live Load = 40 P.S.F.  
 Dead Load = 12 P.S.F.  
 Total Floor Load = 52 P.S.F.  
**Roof Loads:**  
 Live Loads = 42 P.S.F. (snowload)  
 Dead Load = 15 P.S.F.  
 Total Roof Load = 57 P.S.F.

**CLIENT NAME:**

Crescent Homes  
Rockwood Block 1

**LOCATION:**

George St. E,  
Guelph/Eramosa, ON



JANSSEN DESIGN

116063 2nd Line SW,  
Melancthon, ON, L9V 2C5  
Phone #: 519.925.0663  
Fax #: 519.925.1371  
Email: natasha@janssendesign.ca



THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE DESIGNER BEFORE PROCEEDING WITH THE WORK.

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION  
Paul Janssen BCIN 25681

REGISTRATION INFORMATION  
Firm Name: Janssen Design & Construction  
(Div. of JDC Custom Homes Inc.)  
BCIN 32079

FOUNDATION HEIGHTS TO BE VERIFIED ON SITE ACCORDING TO GRADE.  
 MAX. BACKFILL HEIGHT FOR LATERALLY SUPPORTED WALLS IS 7' 6" W/ 8" OR 10" FOUNDATION WALL (20MPa).  
 MAX. BACKFILL HEIGHT FOR LATERALLY UNSUPPORTED WALLS IS 4' 6" W/ 10" CONC. FOUNDATION WALL (20MPa).

WHERE STEP FOOTINGS ARE REQUIRED THE VERTICAL RISE BETWEEN HORIZONTAL PORTIONS SHALL NOT EXCEED 24" AND THE HORIZONTAL DISTANCE BETWEEN RISERS SHALL NOT BE LESS THAN 24".

**DRAWING TITLE:**  
Right Elevation

**DATE:**  
JUNE 21, 2021

**REVISIONS**


**DRAWN BY:**  
NJ


**CHECKED BY:**  
PJ

**PROJECT NO:**  
1905-1023

**A103**

**GLAZING CALCULATIONS**  
 LIMITING DISTANCE: 71' 5 3/4" (21.8 M.)  
 BUILDING FACE AREA: 1071.4 SQ.FT. (99.5 SQ.M.)  
 ALLOWABLE OPENINGS: 100%  
 PROPOSED OPENINGS: 102.7 SQ.FT. (9.6%)

-  HORIZONTAL VINYL SIDING
-  STONE
-  BRICK

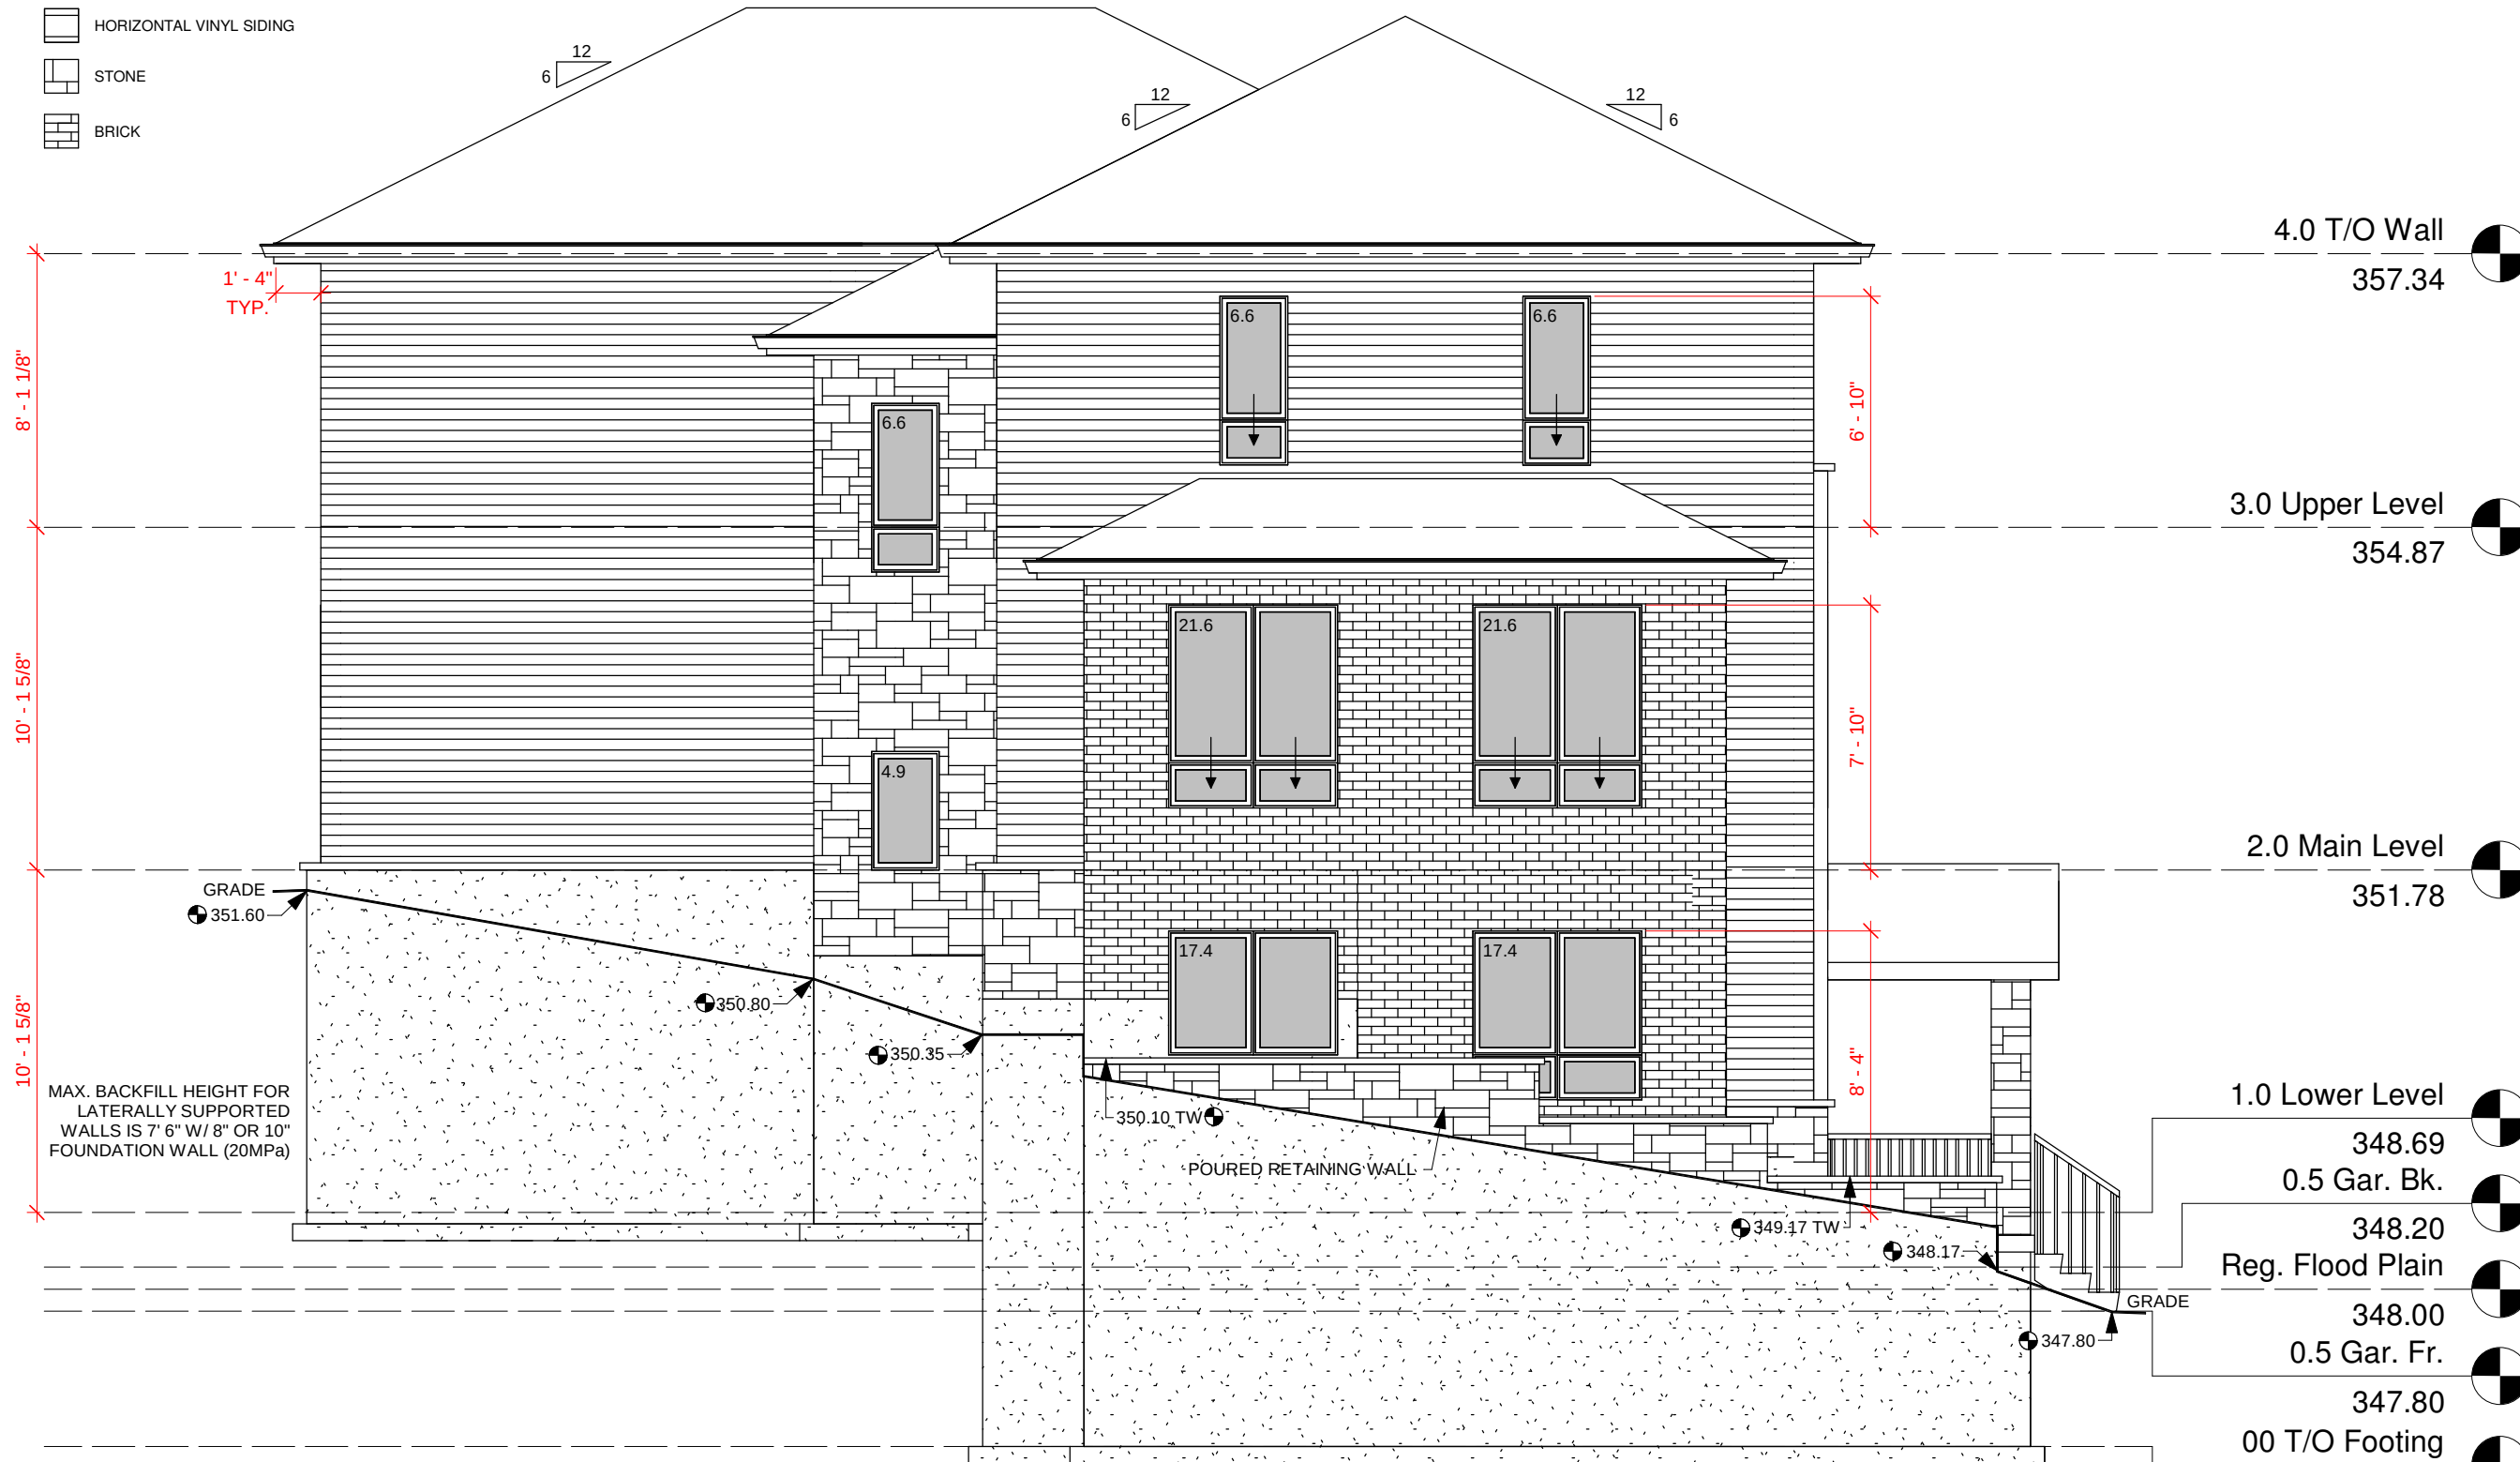

Drawings are only valid for permits after they have been signed. They are only valid for the original address in the titleblock. Do not scale drawings.

**Design Loads Criteria**  
**Floor Loads:**  
 Live Load = 40 P.S.F.  
 Dead Load = 12 P.S.F.  
 Total Floor Load = 52 P.S.F.  
**Roof Loads:**  
 Live Loads = 42 P.S.F. (snowload)  
 Dead Load = 15 P.S.F.  
 Total Roof Load = 57 P.S.F.

**CLIENT NAME:**  
**Crescent Homes**  
 Rockwood Block 1  
**LOCATION:**  
 George St. E,  
 Guelph/Eramosa, ON



**JANSSEN DESIGN**  
 116063 2nd Line SW,  
 Melancthon, ON, L9V 2C5  
 Phone #: 519.925.0663  
 Fax #: 519.925.1371  
 Email: natasha@janssendesign.ca



THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE DESIGNER BEFORE PROCEEDING WITH THE WORK.

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

**QUALIFICATION INFORMATION**  
 Paul Janssen BCIN 25681  
**REGISTRATION INFORMATION**  
 Firm Name: Janssen Design & Construction  
 (Div. of JDC Custom Homes Inc.)  
 BCIN 32079

**DRAWING TITLE:**  
**Left Elevation**


| DATE:                           | REVISIONS   |
|---------------------------------|-------------|
| JUNE 21, 2021                   |             |
| <b>DRAWN BY:</b><br>NJ          |             |
| <b>CHECKED BY:</b><br>PJ        |             |
| <b>PROJECT NO:</b><br>1905-1023 | <b>A104</b> |

**1** Left Elevation  
 3/16" = 1'-0"

1

# T/O Footing

3/16" = 1'-0"

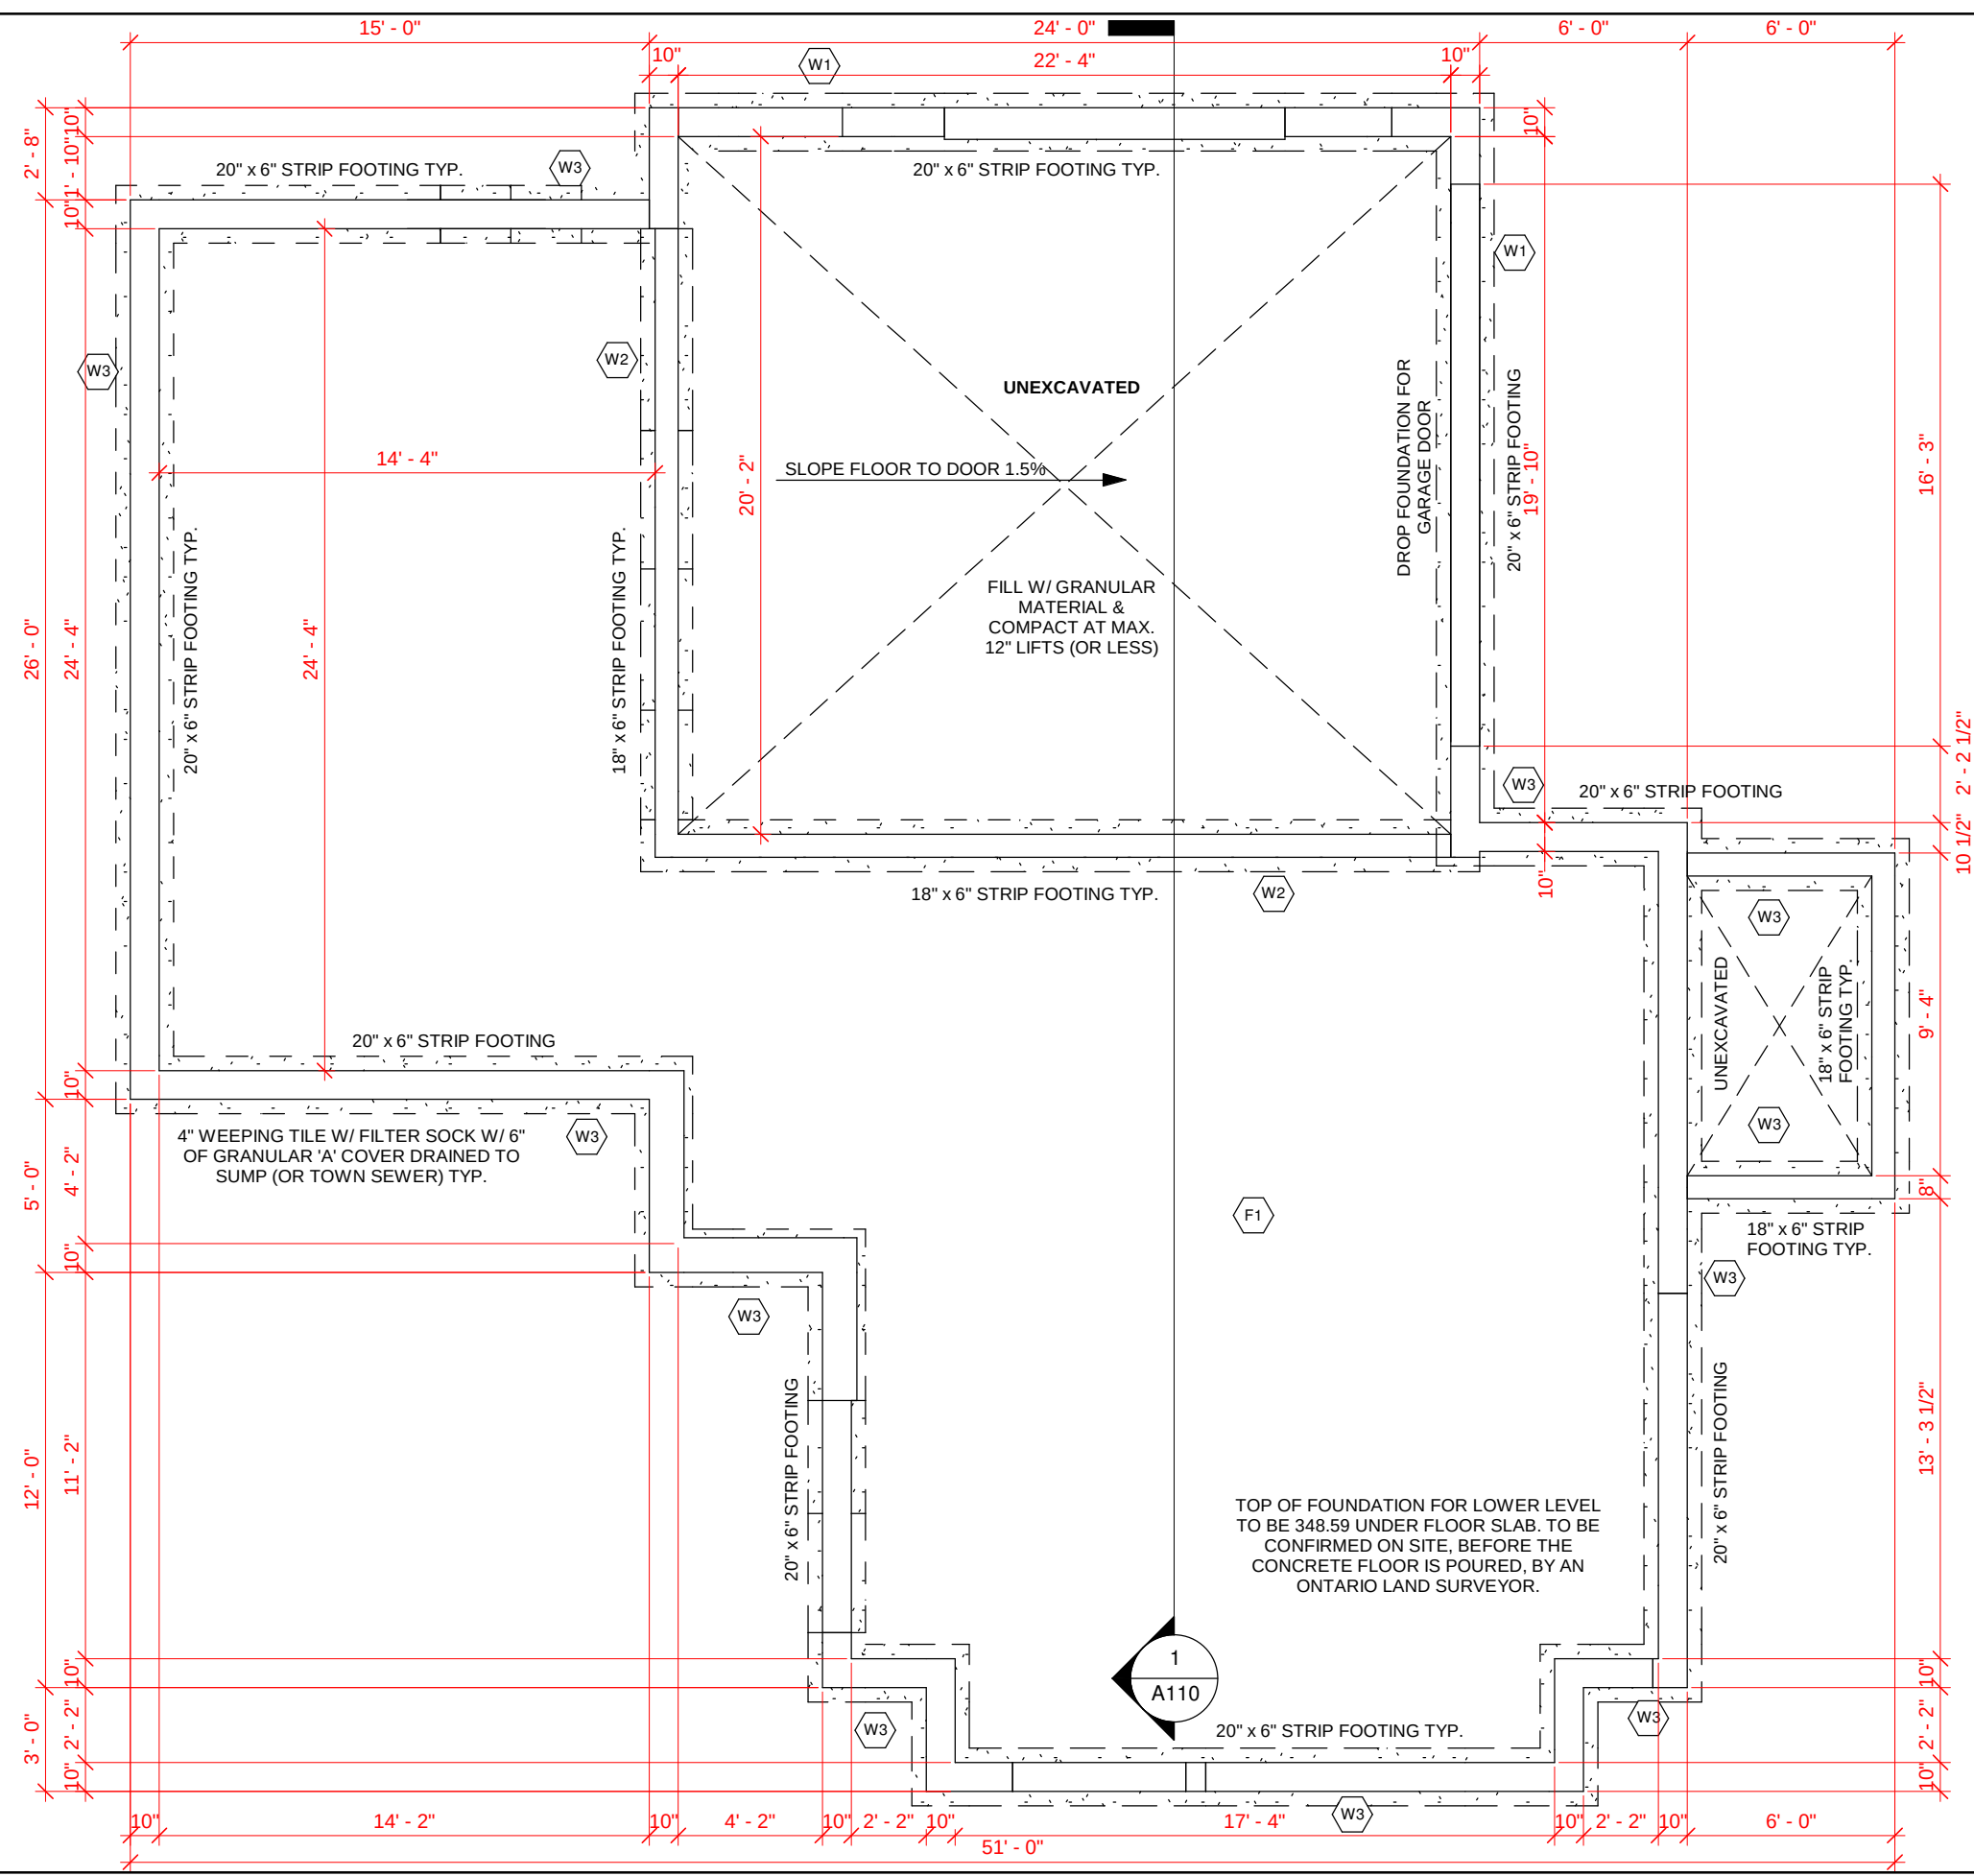

Drawings are only valid for permits after they have been signed. They are only valid for the original address in the titleblock. Do not scale drawings.

**Design Loads Criteria**  
**Floor Loads:**  
 Live Load = 40 P.S.F.  
 Dead Load = 12 P.S.F.  
 Total Floor Load = 52 P.S.F.  
**Roof Loads:**  
 Live Loads = 42 P.S.F. (snowload)  
 Dead Load = 15 P.S.F.  
 Total Roof Load = 57 P.S.F.

**CLIENT NAME:**  
 Crescent Homes  
 Rockwood Block 1

**LOCATION:**  
 George St. E,  
 Guelph/Eramosa, ON



JANSSEN DESIGN  
 116063 2nd Line SW,  
 Melancthon, ON, L9V 2C5  
 Phone #: 519.925.0663  
 Fax #: 519.925.1371  
 Email: natasha@janssendesign.ca



THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE DESIGNER BEFORE PROCEEDING WITH THE WORK.

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

**QUALIFICATION INFORMATION**  
 Paul Janssen BCIN 25681

**REGISTRATION INFORMATION**  
 Firm Name: Janssen Design & Construction  
 (Div. of JDC Custom Homes Inc.)  
 BCIN 32079

**DRAWING TITLE:**  
 00 T/O Footing

| DATE:                           | REVISIONS   |
|---------------------------------|-------------|
| JUNE 21, 2021                   |             |
| <b>DRAWN BY:</b><br>NJ          |             |
| <b>CHECKED BY:</b><br>PJ        |             |
| <b>PROJECT NO:</b><br>1905-1023 | <b>A105</b> |



**LOWER FLOOR/ BASEMENT DOOR SCHEDULE**

Confirm all exterior door dimensions with manufacturer's required rough stud opening sizes prior to start of construction.

| EXTERIOR |  |   |
|----------|--|---|
| D001     | 36" x 80" SINGLE GLASS ENTRY DOOR WITH 2-12" SIDELITES | 1 |
| INTERIOR |  |   |
| D002     | 2-30" x 80" INTERIOR DOUBLE                            | 1 |
| D003     | 36" x 80" INTERIOR DOOR                                | 1 |
| D004     | 36" x 80" INSULATED STEEL DOOR W/ SELF CLOSER          | 1 |

**BASEMENT WINDOW SCHEDULE**

The window schedule on these plans indicates general sizes that reflect available manufacturer's window sizes. Confirm all exterior window dimensions with manufacturers required rough stud opening sizes prior to start of construction.

|      |                    |   |
|------|--------------------|---|
| W001 | 48" x 24" FIXED    | 1 |
| W002 | 60" x 60" CASEMENT | 2 |
| W003 | 36" x 60" FIXED    | 1 |
| W004 | 60" x 60" SLIDING  | 1 |

**GENERAL NOTES & SPECS**

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON SITE.
2. BUILDING TO CONFORM TO LATEST VERSION OF THE ONTARIO BUILDING CODE.
3. CONSTRUCTION TO BE FREE OF DEFECTS & POSSESS GOOD WORKMANSHIP.
4. LUMBER SPECIFICATIONS BASED ON NO. 2 SPF.
5. ALL INTERIOR BASEMENT LINTELS TO BE LVL IN THE FLOOR SYSTEM SPEC'D BY SUPPLIER UNLESS NOTED OTHERWISE.
6. ALL INTERIOR WALLS TO BE 2X4 CONSTRUCTION UNLESS OTHERWISE SPECIFIED.
7. ALL INTERIOR OPENINGS FRAME TO 82 1/2" HIGH & 2" WIDER THAN SHOWN ON DRAWINGS. POCKET DOORS FRAME TO 84 1/2" HIGH.
8. UNLESS OTHERWISE NOTED, ALL LINTELS MIN. 1 1/2" BEARING TO 9' 9" SPAN, 3" BEARING > 9' 9" SPAN.
9. EXTERIOR OPENINGS ARE SHOWN AS SUGGESTED SIZES. CONTRACTOR/OWNER TO VERIFY ACTUAL SIZES.
10. PROTECT ALL WOOD & STEEL SURFACES THAT CONTACT CONCRETE OR MASONRY WITH 6MIL POLY.
11. INTERCONNECTED SMOKE DETECTOR ON ALL FLOORS AS INDICATED. ALARM MUST INCLUDE A VISUAL COMPONENT.
12. CARBON MONOXIDE DETECTOR REQUIRED WHERE ATTACHED GARAGE OR FUEL BURNING APPLIANCES ARE USED. LOCATE DETECTORS OUTSIDE SLEEPING AREA(S).
13. PROVIDE A FAN IN EACH BATHROOM.
14. ALL CLOSETS TO BE 24" DEEP UNLESS NOTED OTHERWISE.
15. INTERIOR DOORS TO BE MIN. 6" FROM WALLS OR CENTERED ON THE WALL IN THE SPACE.
16. ALL BASEMENT EXTERIOR MEASUREMENTS ARE TAKEN TO THE EXTERIOR OF THE FOUNDATION UNLESS OTHERWISE NOTED.
17. ALL INTERIOR BASEMENT MEASUREMENTS ARE TAKEN TO THE INSIDE OF THE FOUNDATION WALL.
18. ALL BASEMENT & MAIN FLOOR WINDOWS WITH BRICK ABOVE TO HAVE A BRICK LINTEL. LINTELS TO BE MIN. L3 1/2" X 3 1/2" X 1/4" UNLESS NOTED OTHERWISE.


**LEGEND**

- SMOKE DETECTOR
- CARBON MONOXIDE DETECTOR
- BATHROOM FAN

**FLOOR AREAS**

|                        |             |
|------------------------|-------------|
| BASEMENT/ LOWER FLOOR: | 637 SQ.FT.  |
| MAIN FLOOR:            | 1434 SQ.FT. |
| SECOND FLOOR:          | 1398 SQ.FT. |
| GARAGE:                | 453 SQ.FT.  |

**1.0 Lower Level**  
3/16" = 1'-0"

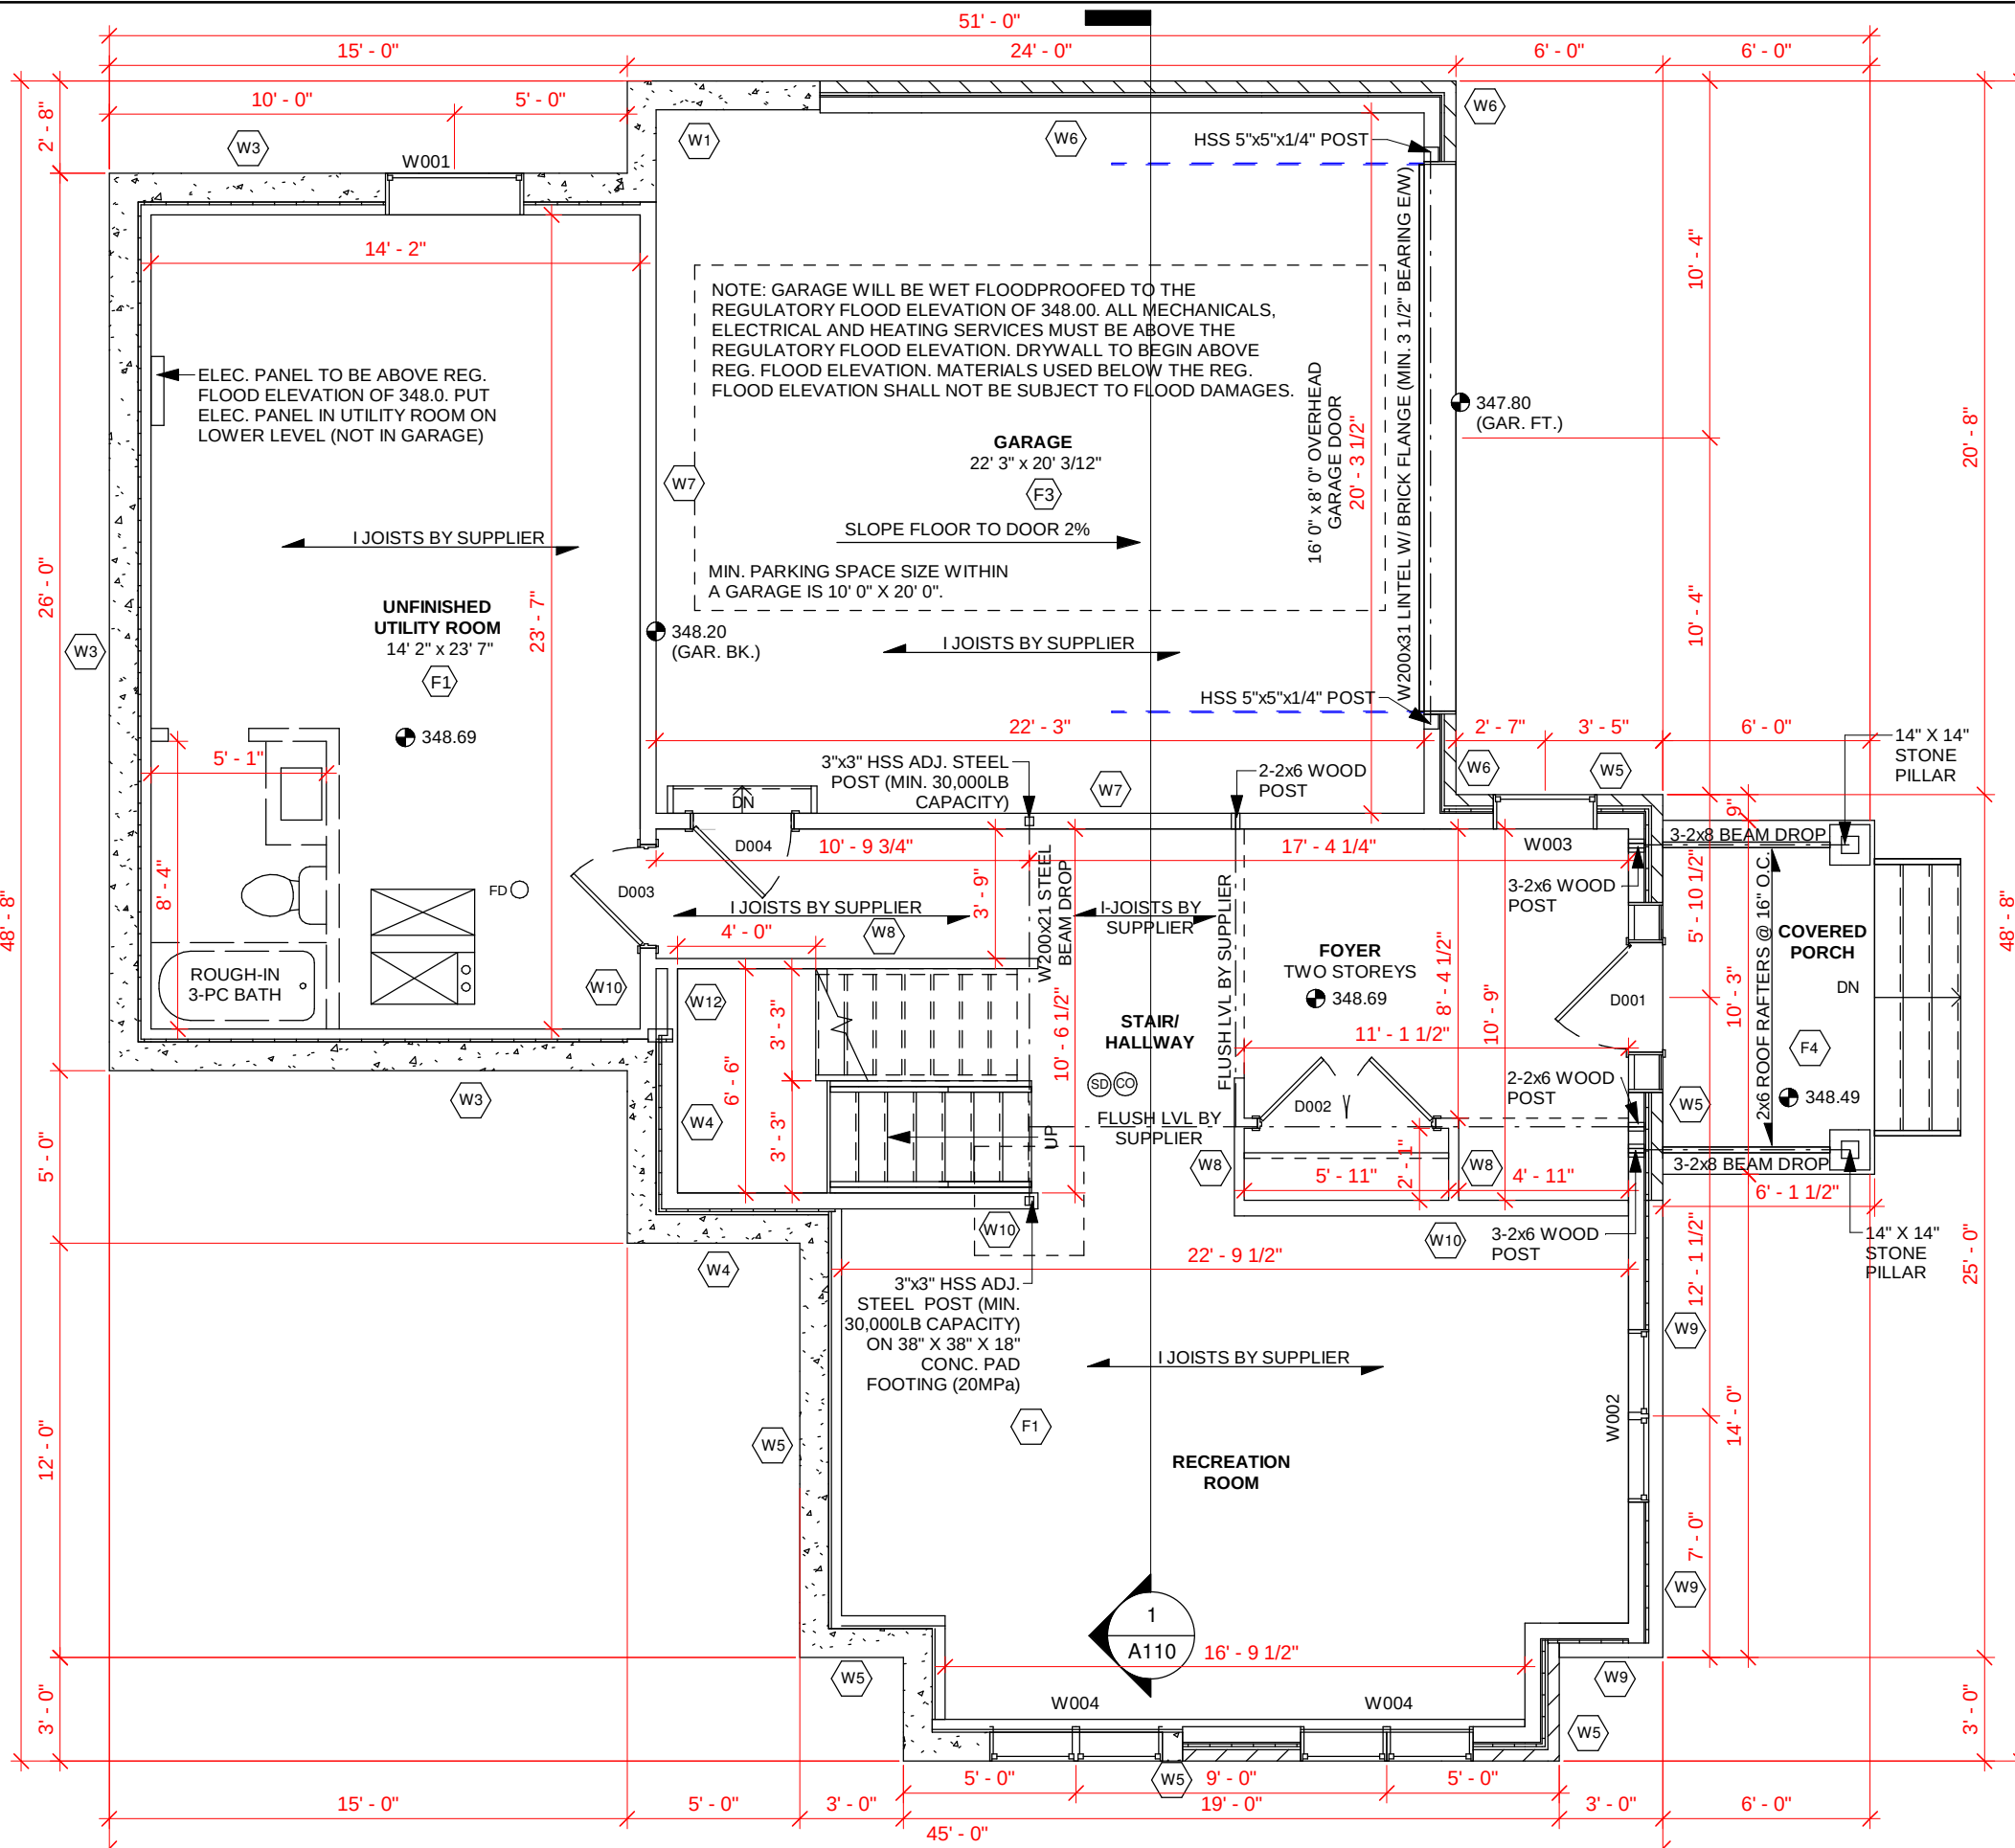

Drawings are only valid for permits after they have been signed. They are only valid for the original address in the titleblock. Do not scale drawings.

**Design Loads Criteria**

**Floor Loads:**  
Live Load = 40 P.S.F.  
Dead Load = 12 P.S.F.  
Total Floor Load = 52 P.S.F.  
**Roof Loads:**  
Live Loads = 42 P.S.F. (snowload)  
Dead Load = 15 P.S.F.  
Total Roof Load = 57 P.S.F.

**CLIENT NAME:**

Crescent Homes

Rockwood Block 1

**LOCATION:**

George St. E,  
Guelph/Eramosa, ON



JANSSEN DESIGN

116063 2nd Line SW,  
Melancthon, ON, L9V 2C5

Phone #: 519.925.0663

Fax #: 519.925.1371

Email: natasha@janssendesign.ca



THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE DESIGNER BEFORE PROCEEDING WITH THE WORK.

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

**QUALIFICATION INFORMATION**  
Paul Janssen BCIN 25681

**REGISTRATION INFORMATION**  
Firm Name: Janssen Design & Construction  
(Div. of JDC Custom Homes Inc.)  
BCIN 32079

**DRAWING TITLE:**

1.0 Lower Level

| DATE:         | REVISIONS |
|---------------|-----------|
| JUNE 21, 2021 |           |

|                        |  |
|------------------------|--|
| <b>DRAWN BY:</b><br>NJ |  |
|------------------------|--|

|                          |  |
|--------------------------|--|
| <b>CHECKED BY:</b><br>PJ |  |
|--------------------------|--|

|                                 |             |
|---------------------------------|-------------|
| <b>PROJECT NO:</b><br>1905-1023 | <b>A106</b> |
|---------------------------------|-------------|

| MAIN FLOOR DOOR SCHEDULE   |                           |   |
|--|---------------------------|---|
| Confirm all exterior door dimensions with manufacturer's required rough stud opening sizes prior to start of construction. |                           |   |
| EXTERIOR   |                           |   |
| D101   | 96" x 84" SLIDING DOOR    | 1 |
| INTERIOR   |                           |   |
| D102   | 30" x 80" INTERIOR DOUBLE | 2 |

| MAIN FLOOR WINDOW SCHEDULE   |                    |   |
|--|--------------------|---|
| The window schedule on these plans indicates general sizes that reflect available manufacturer's window sizes. Confirm all exterior window dimensions with manufacturers required rough stud opening sizes prior to start of construction. |                    |   |
| W101   | 36" x 72" CASEMENT | 3 |
| W102   | 60" x 72" CASEMENT | 1 |
| W103   | 60" x 72" FIXED    | 1 |
| W104   | 24" x 42" FIXED    | 1 |
| W105   | 60" x 36" SLIDING  | 1 |
| W106   | 36" x 72" FIXED    | 1 |
| W107   | 60" x 72" SLIDING  | 3 |

**GENERAL NOTES & SPECS**


1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON SITE.
2. BUILDING TO CONFORM TO LATEST VERSION OF THE ONTARIO BUILDING CODE.
3. CONSTRUCTION TO BE FREE OF DEFECTS & POSSESS GOOD WORKMANSHIP.
4. LUMBER SPECIFICATIONS BASED ON NO. 2 SPF.
5. ALL INTERIOR BASEMENT LINTELS TO BE LVL IN THE FLOOR SYSTEM SPEC'D BY SUPPLIER UNLESS NOTED OTHERWISE.
6. ALL INTERIOR WALLS TO BE 2X4 CONSTRUCTION UNLESS OTHERWISE SPECIFIED.
7. ALL INTERIOR OPENINGS FRAME TO 82 1/2" HIGH & 2" WIDER THAN SHOWN ON DRAWINGS. POCKET DOORS FRAME TO 84 1/2" HIGH.
8. UNLESS OTHERWISE NOTED, ALL LINTELS MIN. 1 1/2" BEARING TO 9' 9" SPAN, 3" BEARING > 9' 9" SPAN.
9. EXTERIOR OPENINGS ARE SHOWN AS SUGGESTED SIZES. CONTRACTOR/OWNER TO VERIFY ACTUAL SIZES.
10. PROTECT ALL WOOD & STEEL SURFACES THAT CONTACT CONCRETE OR MASONRY WITH 6MIL POLY.
11. INTERCONNECTED SMOKE DETECTOR ON ALL FLOORS AS INDICATED. ALARM MUST INCLUDE A VISUAL COMPONENT.
12. CARBON MONOXIDE DETECTOR REQUIRED WHERE ATTACHED GARAGE OR FUEL BURNING APPLIANCES ARE USED. LOCATE DETECTORS OUTSIDE SLEEPING AREA(S).
13. PROVIDE A FAN IN EACH BATHROOM.
13. ALL CLOSETS TO BE 24" DEEP UNLESS NOTED OTHERWISE.
14. INTERIOR DOORS TO BE MIN. 6" FROM WALLS OR CENTERED ON THE WALL IN THE SPACE.
15. ALL BASEMENT EXTERIOR MEASUREMENTS ARE TAKEN TO THE EXTERIOR OF THE FOUNDATION UNLESS OTHERWISE NOTED.
16. ALL INTERIOR BASEMENT MEASUREMENTS ARE TAKEN TO THE INSIDE OF THE FOUNDATION WALL.
17. ALL BASEMENT & MAIN FLOOR WINDOWS WITH BRICK ABOVE TO HAVE A BRICK LINTEL. LINTELS TO BE MIN. L3 1/2" X 3 1/2" X 1/4" UNLESS NOTED OTHERWISE.

- LEGEND**
- (SD) SMOKE DETECTOR
  - (CO) CARBON MONOXIDE DETECTOR
  - (BF) BATHROOM FAN

**FLOOR AREAS**

|                        |             |
|------------------------|-------------|
| BASEMENT/ LOWER FLOOR: | 637 SQ.FT.  |
| MAIN FLOOR:            | 1434 SQ.FT. |
| SECOND FLOOR:          | 1398 SQ.FT. |
| GARAGE:                | 453 SQ.FT.  |

**1 2.0 Main Level**  
3/16" = 1'-0"

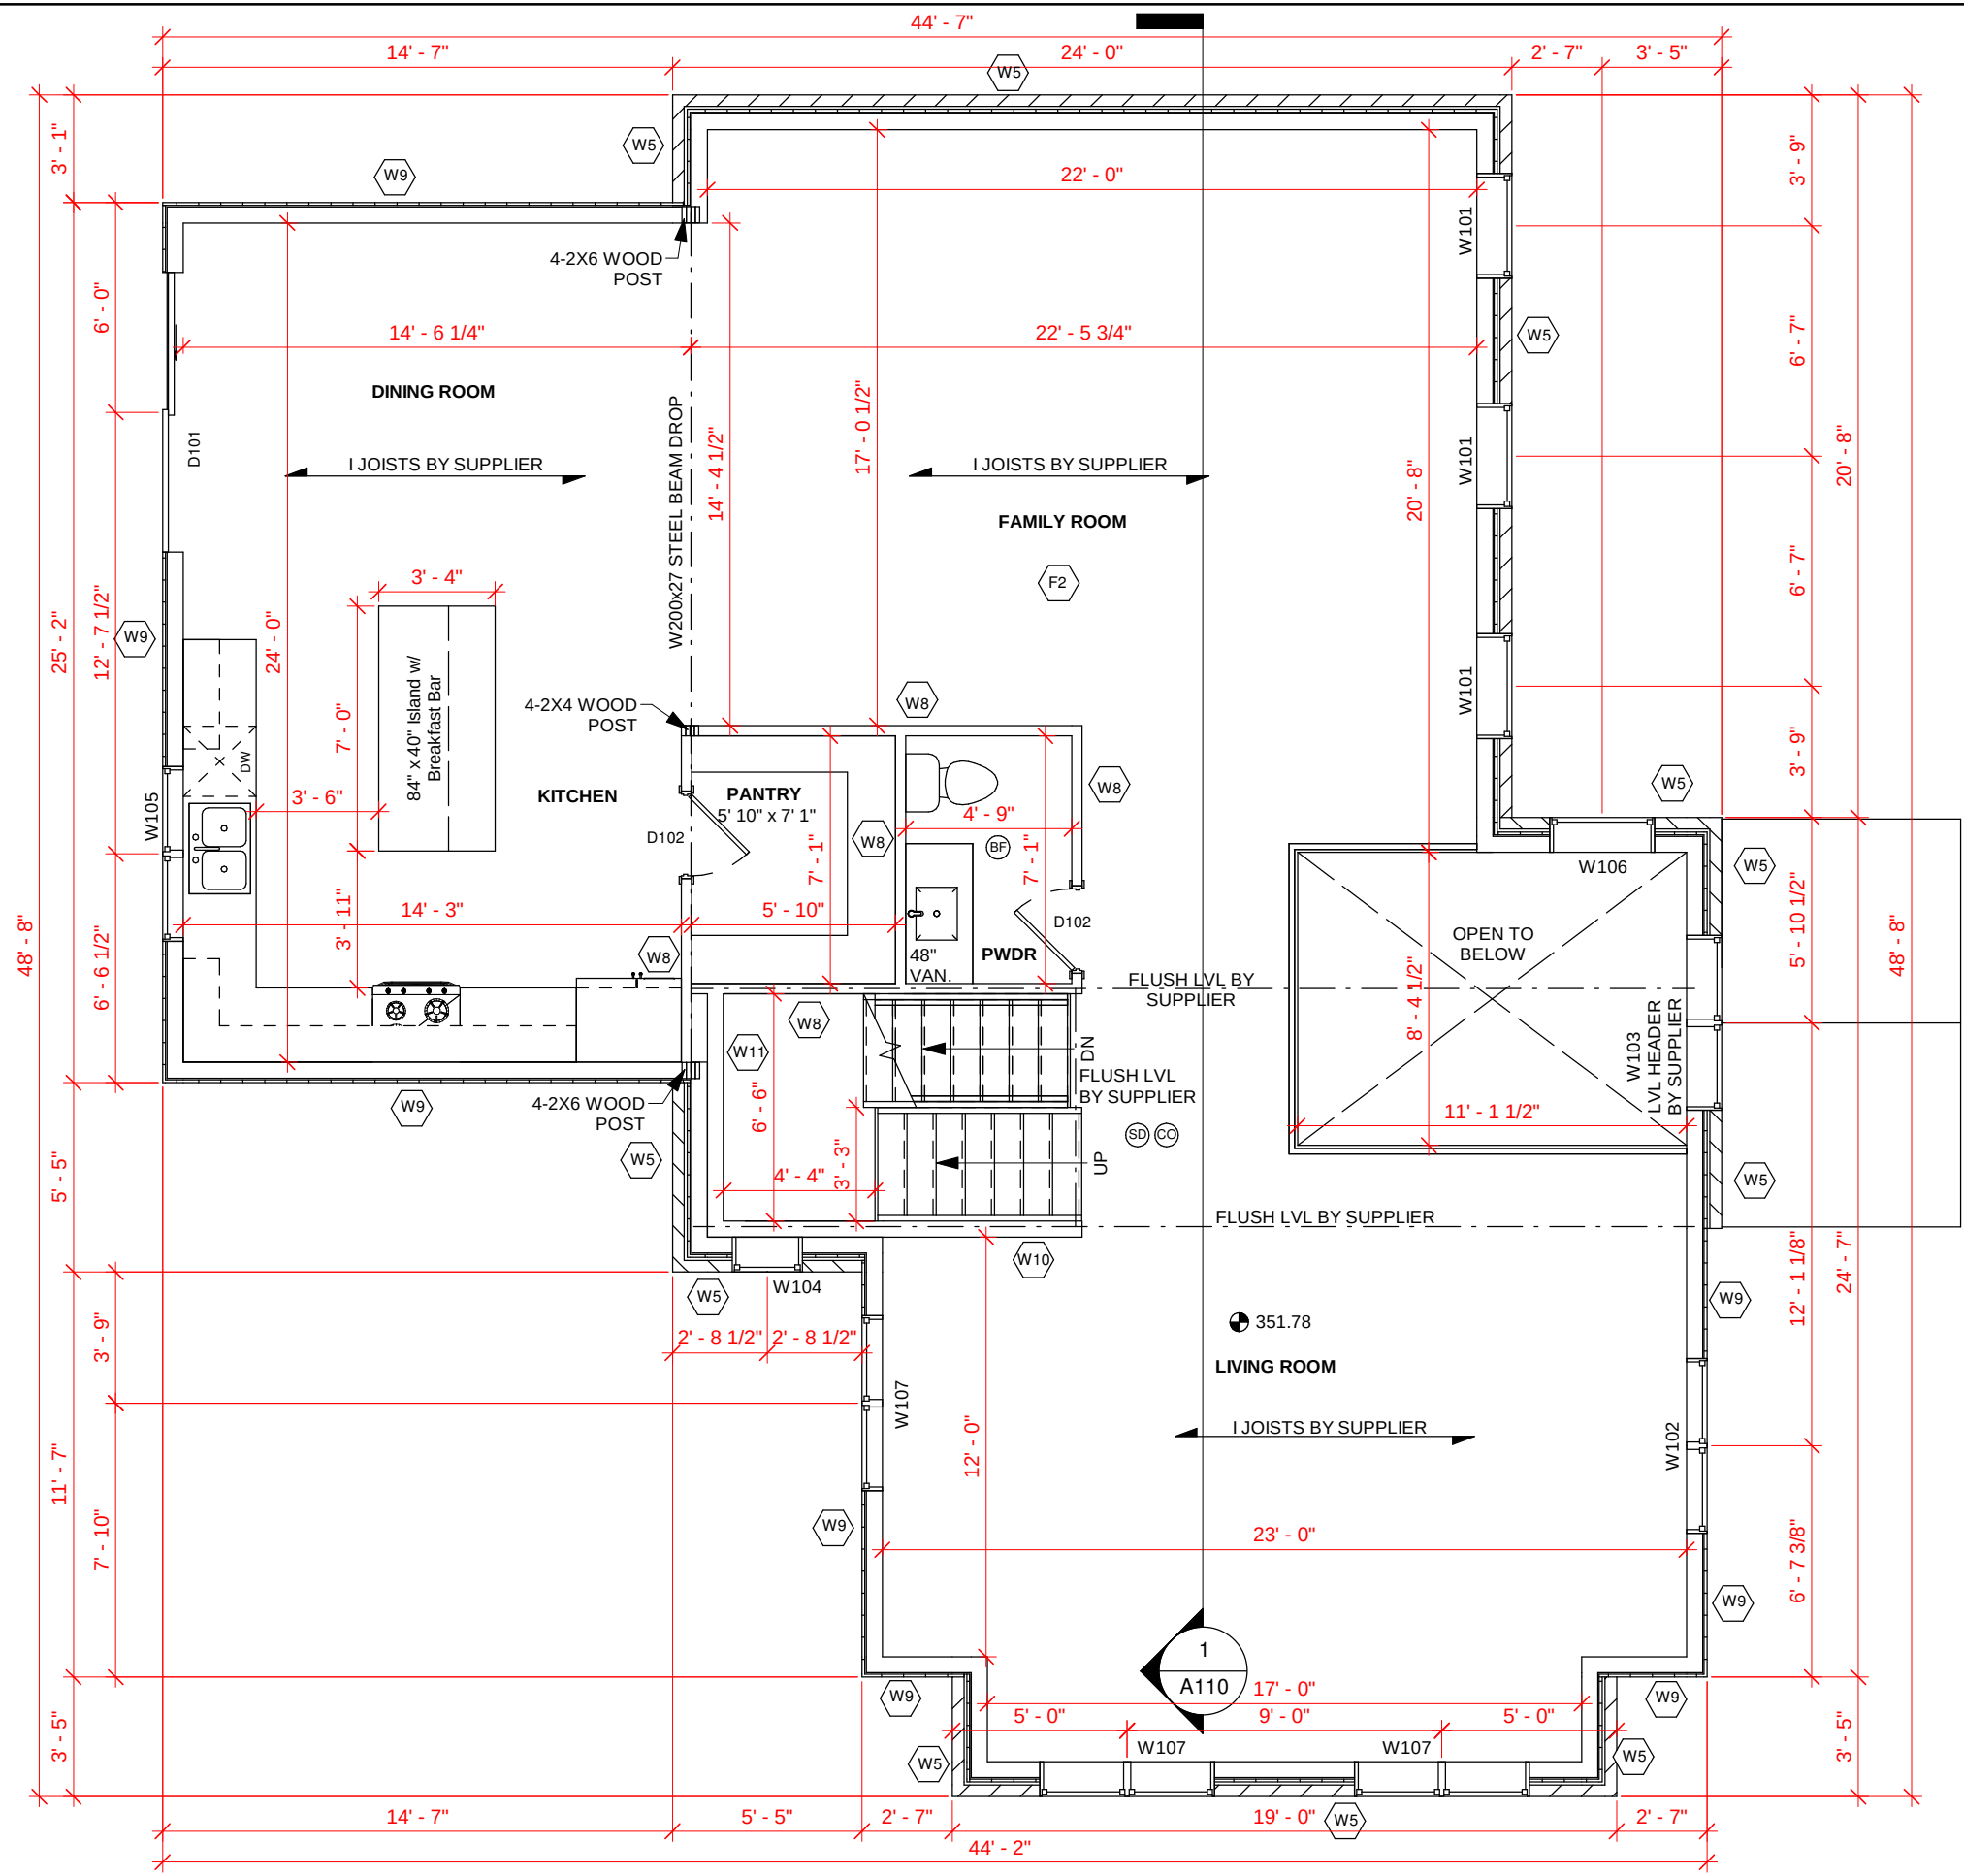

Drawings are only valid for permits after they have been signed. They are only valid for the original address in the titleblock. Do not scale drawings.

**Design Loads Criteria**  
 Floor Loads:  
 Live Load = 40 P.S.F.  
 Dead Load = 12 P.S.F.  
 Total Floor Load = 52 P.S.F.  
 Roof Loads:  
 Live Loads = 42 P.S.F. (snowload)  
 Dead Load = 15 P.S.F.  
 Total Roof Load = 57 P.S.F.

**CLIENT NAME:**  
 Crescent Homes  
 Rockwood Block 1  
**LOCATION:**  
 George St. E,  
 Guelph/Eramosa, ON



JANSSEN DESIGN  
 116063 2nd Line SW,  
 Melancthon, ON, L9V 2C5  
 Phone #: 519.925.0663  
 Fax #: 519.925.1371  
 Email: natasha@janssendesign.ca



THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE DESIGNER BEFORE PROCEEDING WITH THE WORK.

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

**QUALIFICATION INFORMATION**  
 Paul Janssen BCIN 25681  
**REGISTRATION INFORMATION**  
 Firm Name: Janssen Design & Construction  
 (Div. of JDC Custom Homes Inc.)  
 BCIN 32079

**DRAWING TITLE:**  
 2.0 Main Level

| DATE:                           | REVISIONS   |
|---------------------------------|-------------|
| JUNE 21, 2021                   |             |
| <b>DRAWN BY:</b><br>NJ          |             |
| <b>CHECKED BY:</b><br>PJ        |             |
| <b>PROJECT NO:</b><br>1905-1023 | <b>A107</b> |

| SECOND FLOOR DOOR SCHEDULE   |                                  |   |
|--|----------------------------------|---|
| Confirm all exterior door dimensions with manufacturer's required rough stud opening sizes prior to start of construction. |                                  |   |
| D201   | 32" x 80" INTERIOR DOOR          | 4 |
| D202   | 30" x 80" INTERIOR DOOR          | 5 |
| D203   | 2-30" x 80" INTERIOR DOUBLE DOOR | 2 |
| D204   | 2-26" x 80" INTERIOR DOUBLE DOOR | 1 |

| SECOND FLOOR WINDOW SCHEDULE  |                    |   |
|---|--------------------|---|
| The window schedule on these plans indicates general sizes that reflect available manufacturer's window sizes. Confirm all exterior window dimensions with manufacturer's required rough stud opening sizes prior to start of construction. |                    |   |
| W201  | 60" x 60" CASEMENT | 1 |
| W202  | 24" x 60" SLIDING  | 2 |
| W203  | 60" x 24" FIXED    | 1 |
| W204  | 36" x 60" CASEMENT | 2 |
| W205  | 24" x 60" FIXED    | 1 |
| W206  | 60" x 60" SLIDING  | 2 |

**GENERAL NOTES & SPECS**

1. CONTRACTOR TO VERIFY ALL DIMENSIONS ON SITE.
2. BUILDING TO CONFORM TO LATEST VERSION OF THE ONTARIO BUILDING CODE.
3. CONSTRUCTION TO BE FREE OF DEFECTS & POSSESS GOOD WORKMANSHIP.
4. LUMBER SPECIFICATIONS BASED ON NO. 2 SPF.
5. ALL INTERIOR BASEMENT LINTELS TO BE LVL IN THE FLOOR SYSTEM SPEC'D BY SUPPLIER UNLESS NOTED OTHERWISE.
6. ALL INTERIOR WALLS TO BE 2X4 CONSTRUCTION UNLESS OTHERWISE SPECIFIED.
7. ALL INTERIOR OPENINGS FRAME TO 82 1/2" HIGH & 2" WIDER THAN SHOWN ON DRAWINGS. POCKET DOORS FRAME TO 84 1/2" HIGH.
8. UNLESS OTHERWISE NOTED, ALL LINTELS MIN. 1 1/2" BEARING TO 9' 9" SPAN, 3" BEARING > 9' 9" SPAN.
9. EXTERIOR OPENINGS ARE SHOWN AS SUGGESTED SIZES. CONTRACTOR/OWNER TO VERIFY ACTUAL SIZES.
10. PROTECT ALL WOOD & STEEL SURFACES THAT CONTACT CONCRETE OR MASONRY WITH 6ML POLY.
11. INTERCONNECTED SMOKE DETECTOR ON ALL FLOORS AS INDICATED. ALARM MUST INCLUDE A VISUAL COMPONENT.
12. CARBON MONOXIDE DETECTOR REQUIRED WHERE ATTACHED GARAGE OR FUEL BURNING APPLIANCES ARE USED. LOCATE DETECTORS OUTSIDE SLEEPING AREA(S).
13. PROVIDE A FAN IN EACH BATHROOM.
13. ALL CLOSETS TO BE 24" DEEP UNLESS NOTED OTHERWISE.
14. INTERIOR DOORS TO BE MIN. 6" FROM WALLS OR CENTERED ON THE WALL IN THE SPACE.
15. ALL BASEMENT EXTERIOR MEASUREMENTS ARE TAKEN TO THE EXTERIOR OF THE FOUNDATION UNLESS OTHERWISE NOTED.
16. ALL INTERIOR BASEMENT MEASUREMENTS ARE TAKEN TO THE INSIDE OF THE FOUNDATION WALL.
17. ALL BASEMENT & MAIN FLOOR WINDOWS WITH BRICK ABOVE TO HAVE A BRICK LINTEL. LINTELS TO BE MIN. L3 1/2" X 3 1/2" X 1/4" UNLESS NOTED OTHERWISE.


**LEGEND**

- SMOKE DETECTOR
- CARBON MONOXIDE DETECTOR
- BATHROOM FAN

**FLOOR AREAS**

BASEMENT/ LOWER FLOOR: 637 SQ.FT.  
 MAIN FLOOR: 1434 SQ.FT.  
 SECOND FLOOR: 1398 SQ.FT.  
 GARAGE: 453 SQ.FT.

**1** 3.0 Upper Level  
 3/16" = 1'-0"

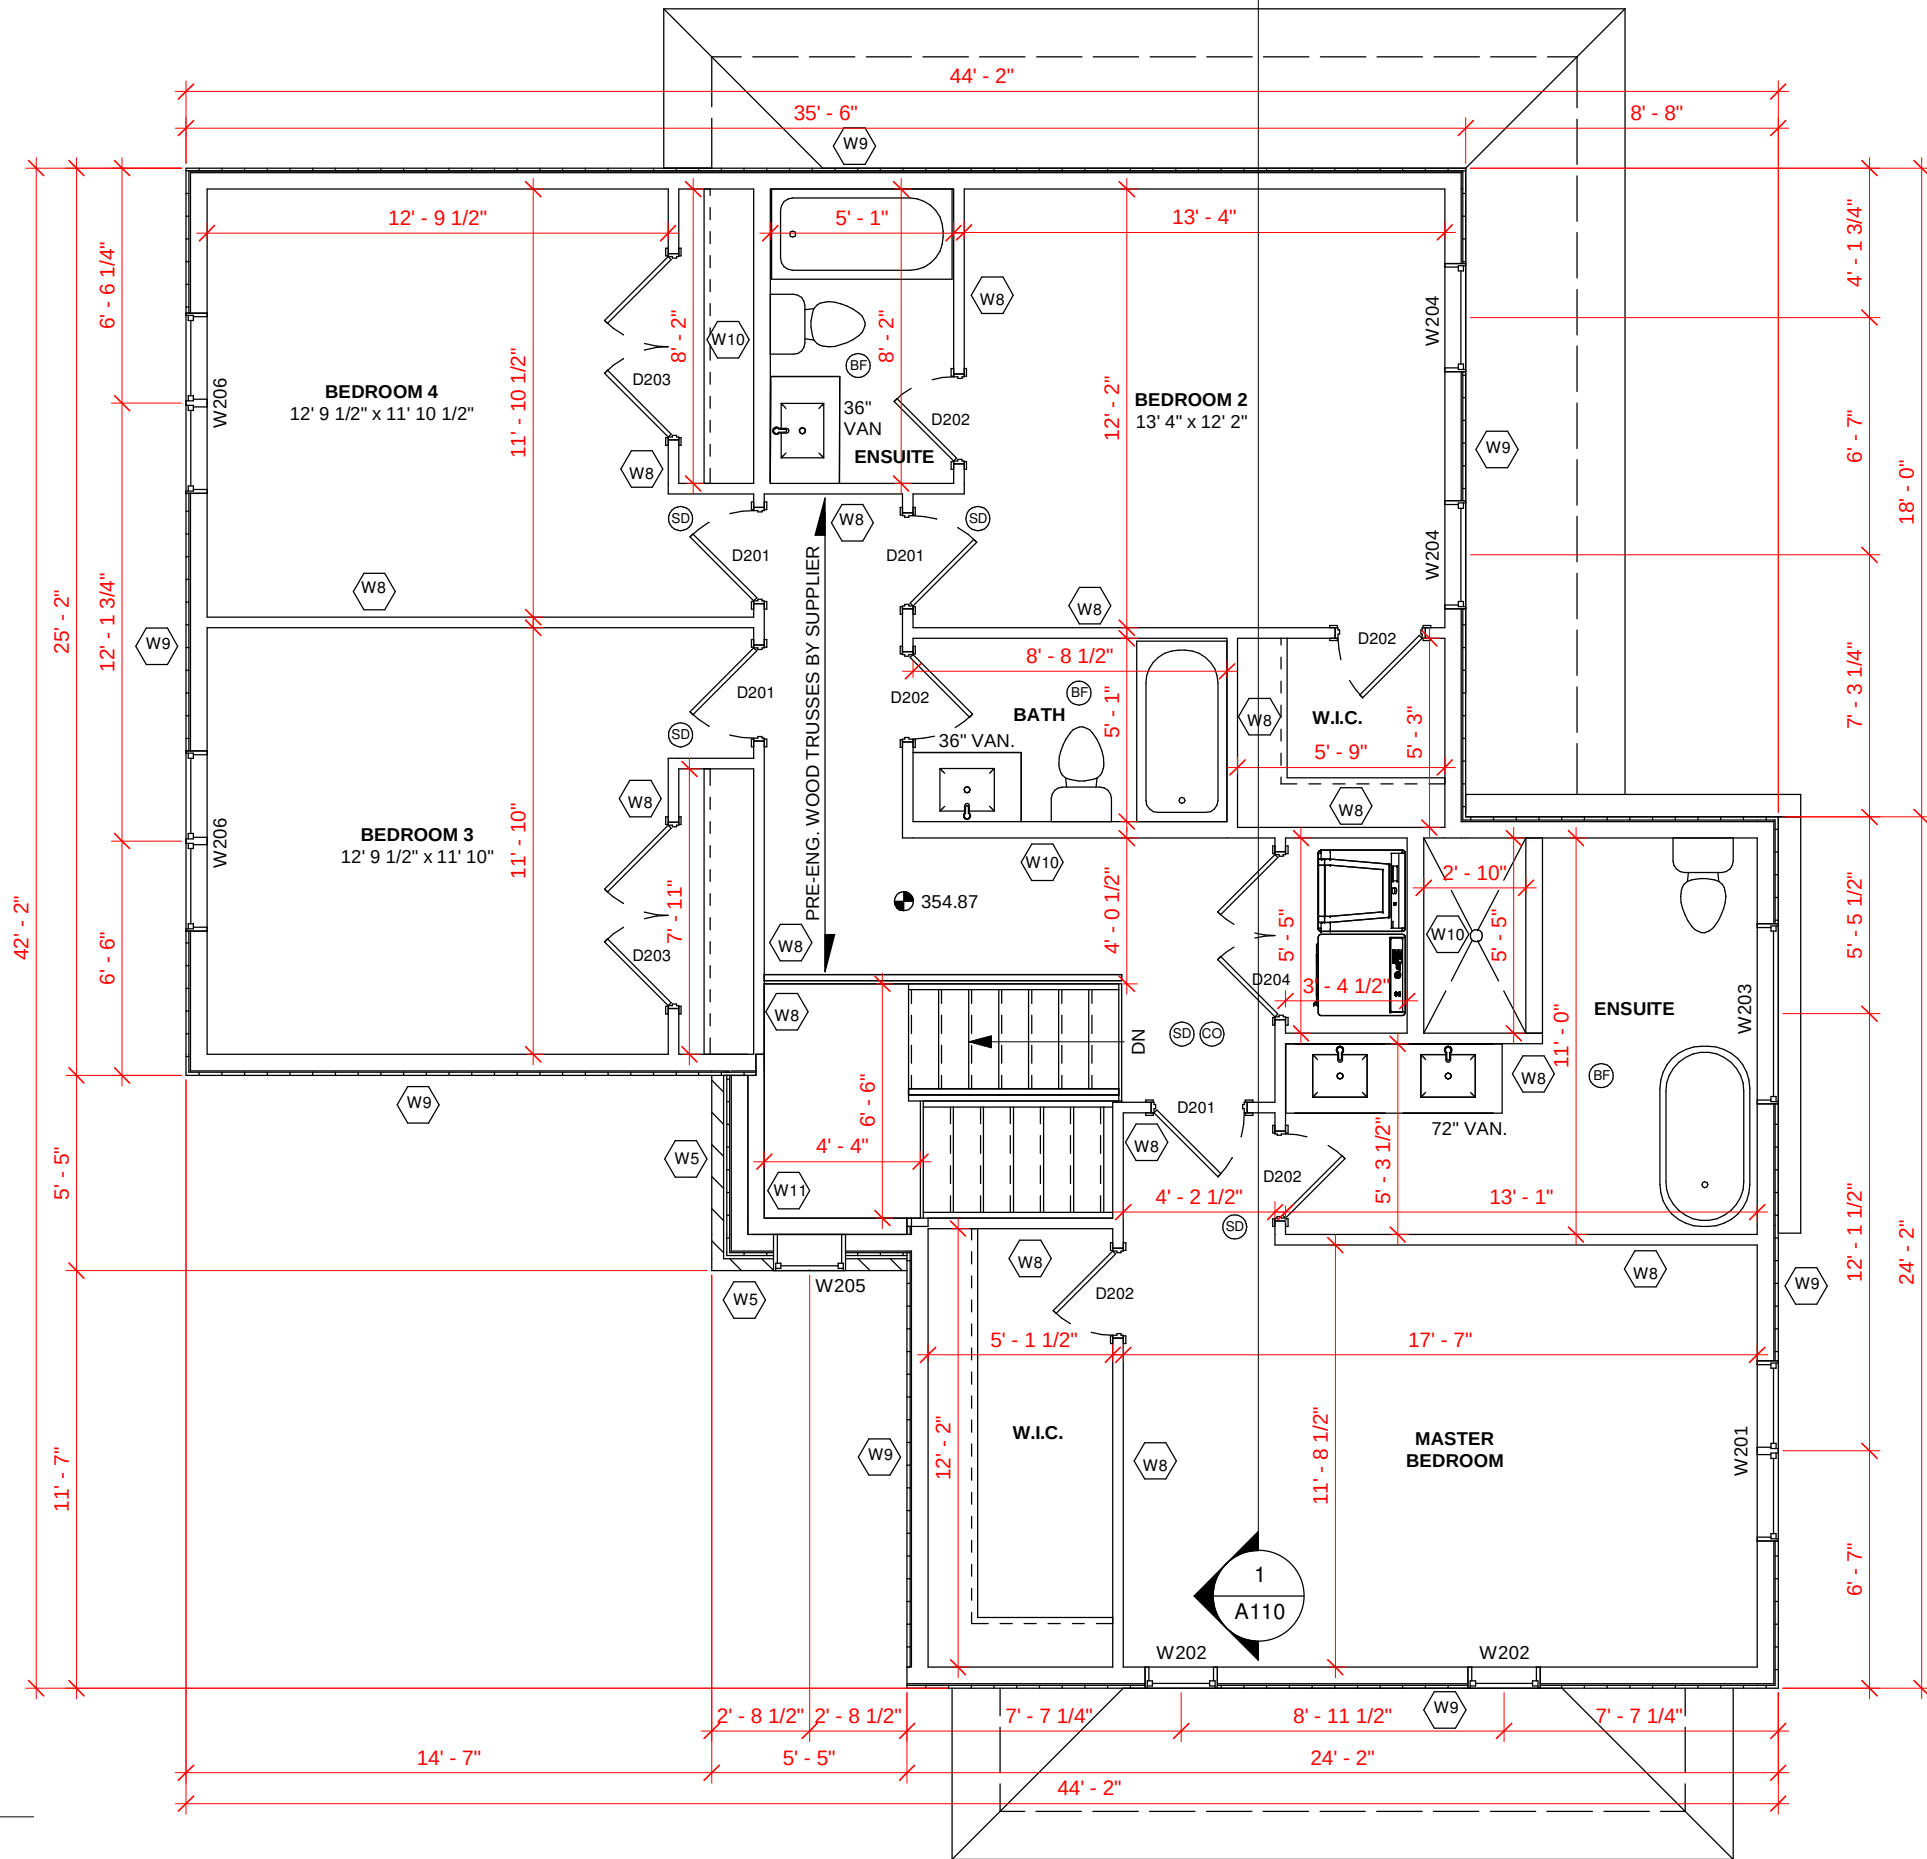

Drawings are only valid for permits after they have been signed. They are only valid for the original address in the titleblock. Do not scale drawings.

**Design Loads Criteria**

**Floor Loads:**  
 Live Load = 40 P.S.F.  
 Dead Load = 12 P.S.F.  
 Total Floor Load = 52 P.S.F.  
**Roof Loads:**  
 Live Loads = 42 P.S.F. (snowload)  
 Dead Load = 15 P.S.F.  
 Total Roof Load = 57 P.S.F.

**CLIENT NAME:**

Crescent Homes

Rockwood Block 1

**LOCATION:**

George St. E,  
 Guelph/Eramosa, ON



JANSSEN DESIGN

116063 2nd Line SW,  
 Melancthon, ON, L9V 2C5

Phone #: 519.925.0663

Fax #: 519.925.1371

Email: natasha@janssendesign.ca



THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE DESIGNER BEFORE PROCEEDING WITH THE WORK.

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION  
 Paul Janssen BCIN 25681

REGISTRATION INFORMATION  
 Firm Name: Janssen Design & Construction  
 (Div. of JDC Custom Homes Inc.)  
 BCIN 32079

**DRAWING TITLE:**

3.0 Upper Level

**DATE:**

JUNE 21, 2021

**REVISIONS**

**DRAWN BY:**

NJ

**CHECKED BY:**


PJ

**PROJECT NO:**

1905-1023

**A108**



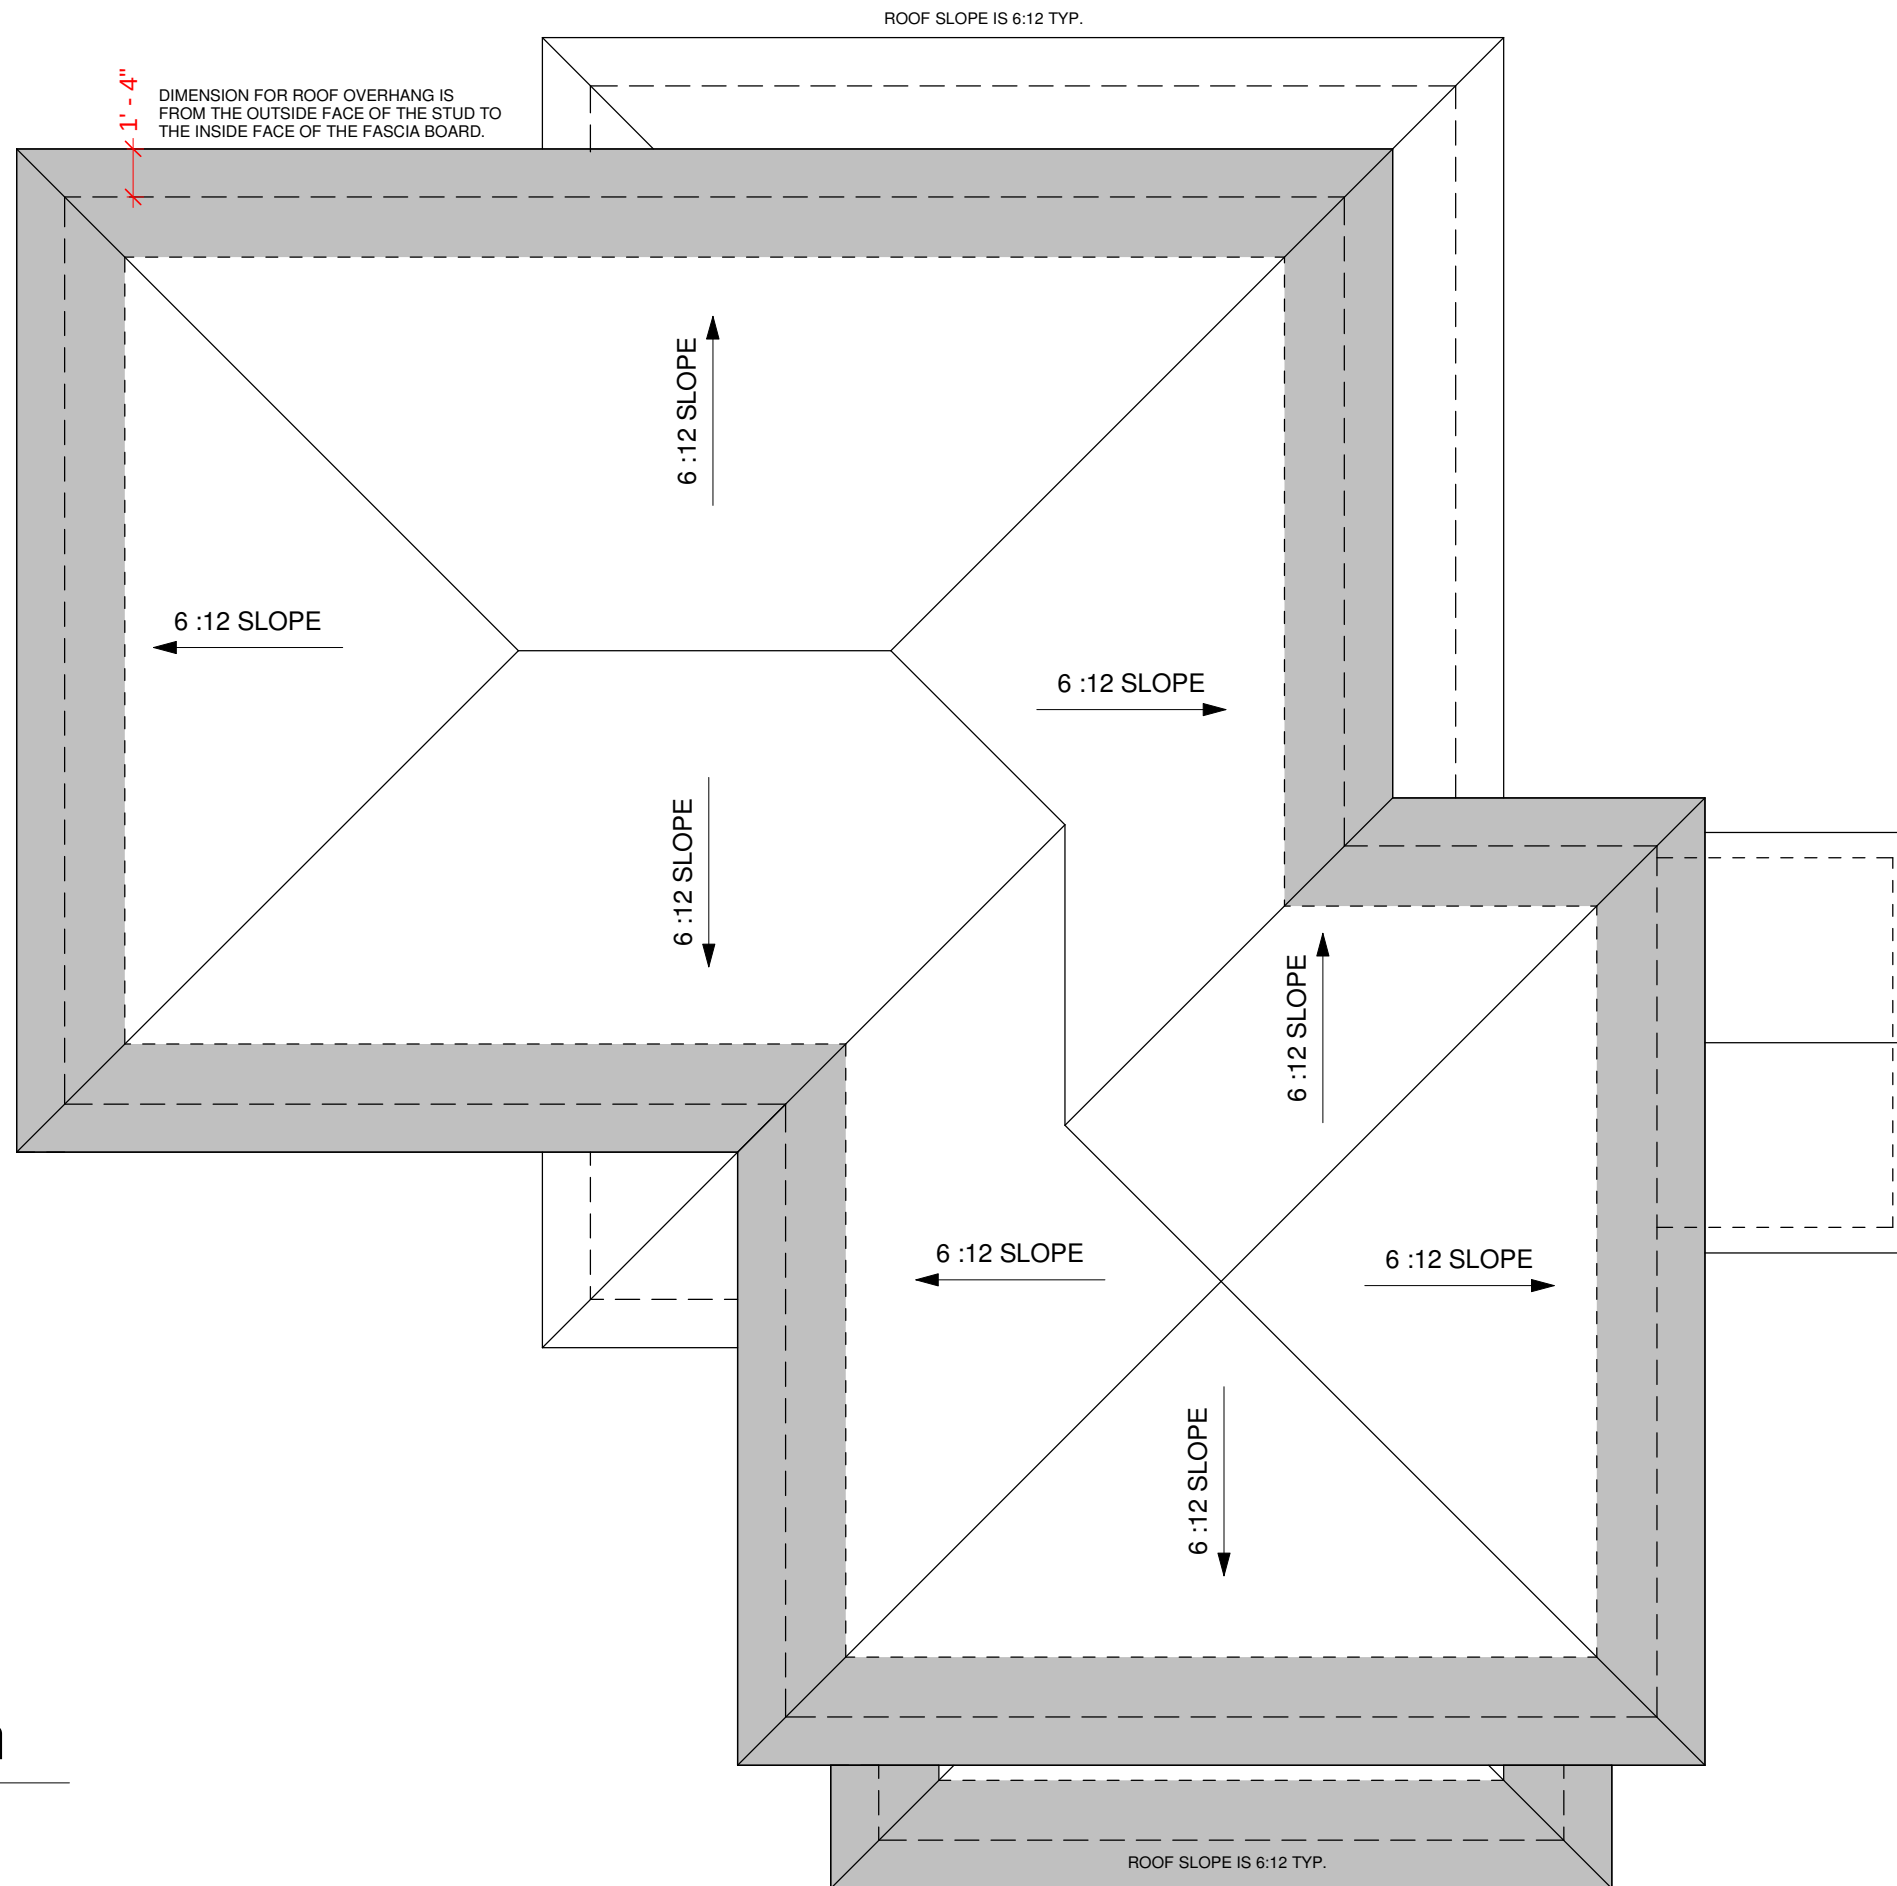

**1** Roof Plan  
3/16" = 1'-0"

Drawings are only valid for permits after they have been signed. They are only valid for the original address in the titleblock. Do not scale drawings.

**Design Loads Criteria**

**Floor Loads:**  
Live Load = 40 P.S.F.  
Dead Load = 12 P.S.F.  
Total Floor Load = 52 P.S.F.

**Roof Loads:**  
Live Loads = 42 P.S.F. (snowload)  
Dead Load = 15 P.S.F.  
Total Roof Load = 57 P.S.F.

**CLIENT NAME:**

**Crescent Homes**  
Rockwood Block 1

**LOCATION:**

George St. E,  
Guelph/Eramosa, ON



JANSSEN DESIGN

116063 2nd Line SW,  
Melancthon, ON, L9V 2C5

Phone #: 519.925.0663

Fax #: 519.925.1371

Email: natasha@janssendesign.ca



THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE DESIGNER BEFORE PROCEEDING WITH THE WORK.

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION  
Paul Janssen BCIN 25681

REGISTRATION INFORMATION  
Firm Name: Janssen Design & Construction  
(Div. of JDC Custom Homes Inc.)  
BCIN 32079

**DRAWING TITLE:**

**Roof Plan**

**DATE:**  
JUNE 21, 2021

**REVISIONS**

**DRAWN BY:**  
NJ

**CHECKED BY:**  
PJ

**PROJECT NO:**  
1905-1023

**A109**



Drawings are only valid for permits after they have been signed. They are only valid for the original address in the titleblock. Do not scale drawings.

**Design Loads Criteria**

**Floor Loads:**  
 Live Load = 40 P.S.F.  
 Dead Load = 12 P.S.F.  
 Total Floor Load = 52 P.S.F.  
**Roof Loads:**  
 Live Loads = 42 P.S.F. (snowload)  
 Dead Load = 15 P.S.F.  
 Total Roof Load = 57 P.S.F.

**CLIENT NAME:**

**Crescent Homes**

Rockwood Block 1

**LOCATION:**

George St. E,  
 Guelph/Eramosa, ON



JANSSEN DESIGN

116063 2nd Line SW,  
 Melancthon, ON, L9V 2C5

Phone #: 519.925.0663

Fax #: 519.925.1371

Email: natasha@janssendesign.ca



THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE DESIGNER BEFORE PROCEEDING WITH THE WORK.

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

**QUALIFICATION INFORMATION**  
 Paul Janssen BCIN 25681

**REGISTRATION INFORMATION**  
 Firm Name: Janssen Design & Construction  
 (Div. of JDC Custom Homes Inc.)  
 BCIN 32079

**DRAWING TITLE:**

**Stair Section**

**DATE:**  
 JUNE 21, 2021


**REVISIONS**

**DRAWN BY:**  
 NJ

**CHECKED BY:**  
 PJ

**PROJECT NO:**  
 1905-1023

**A111**

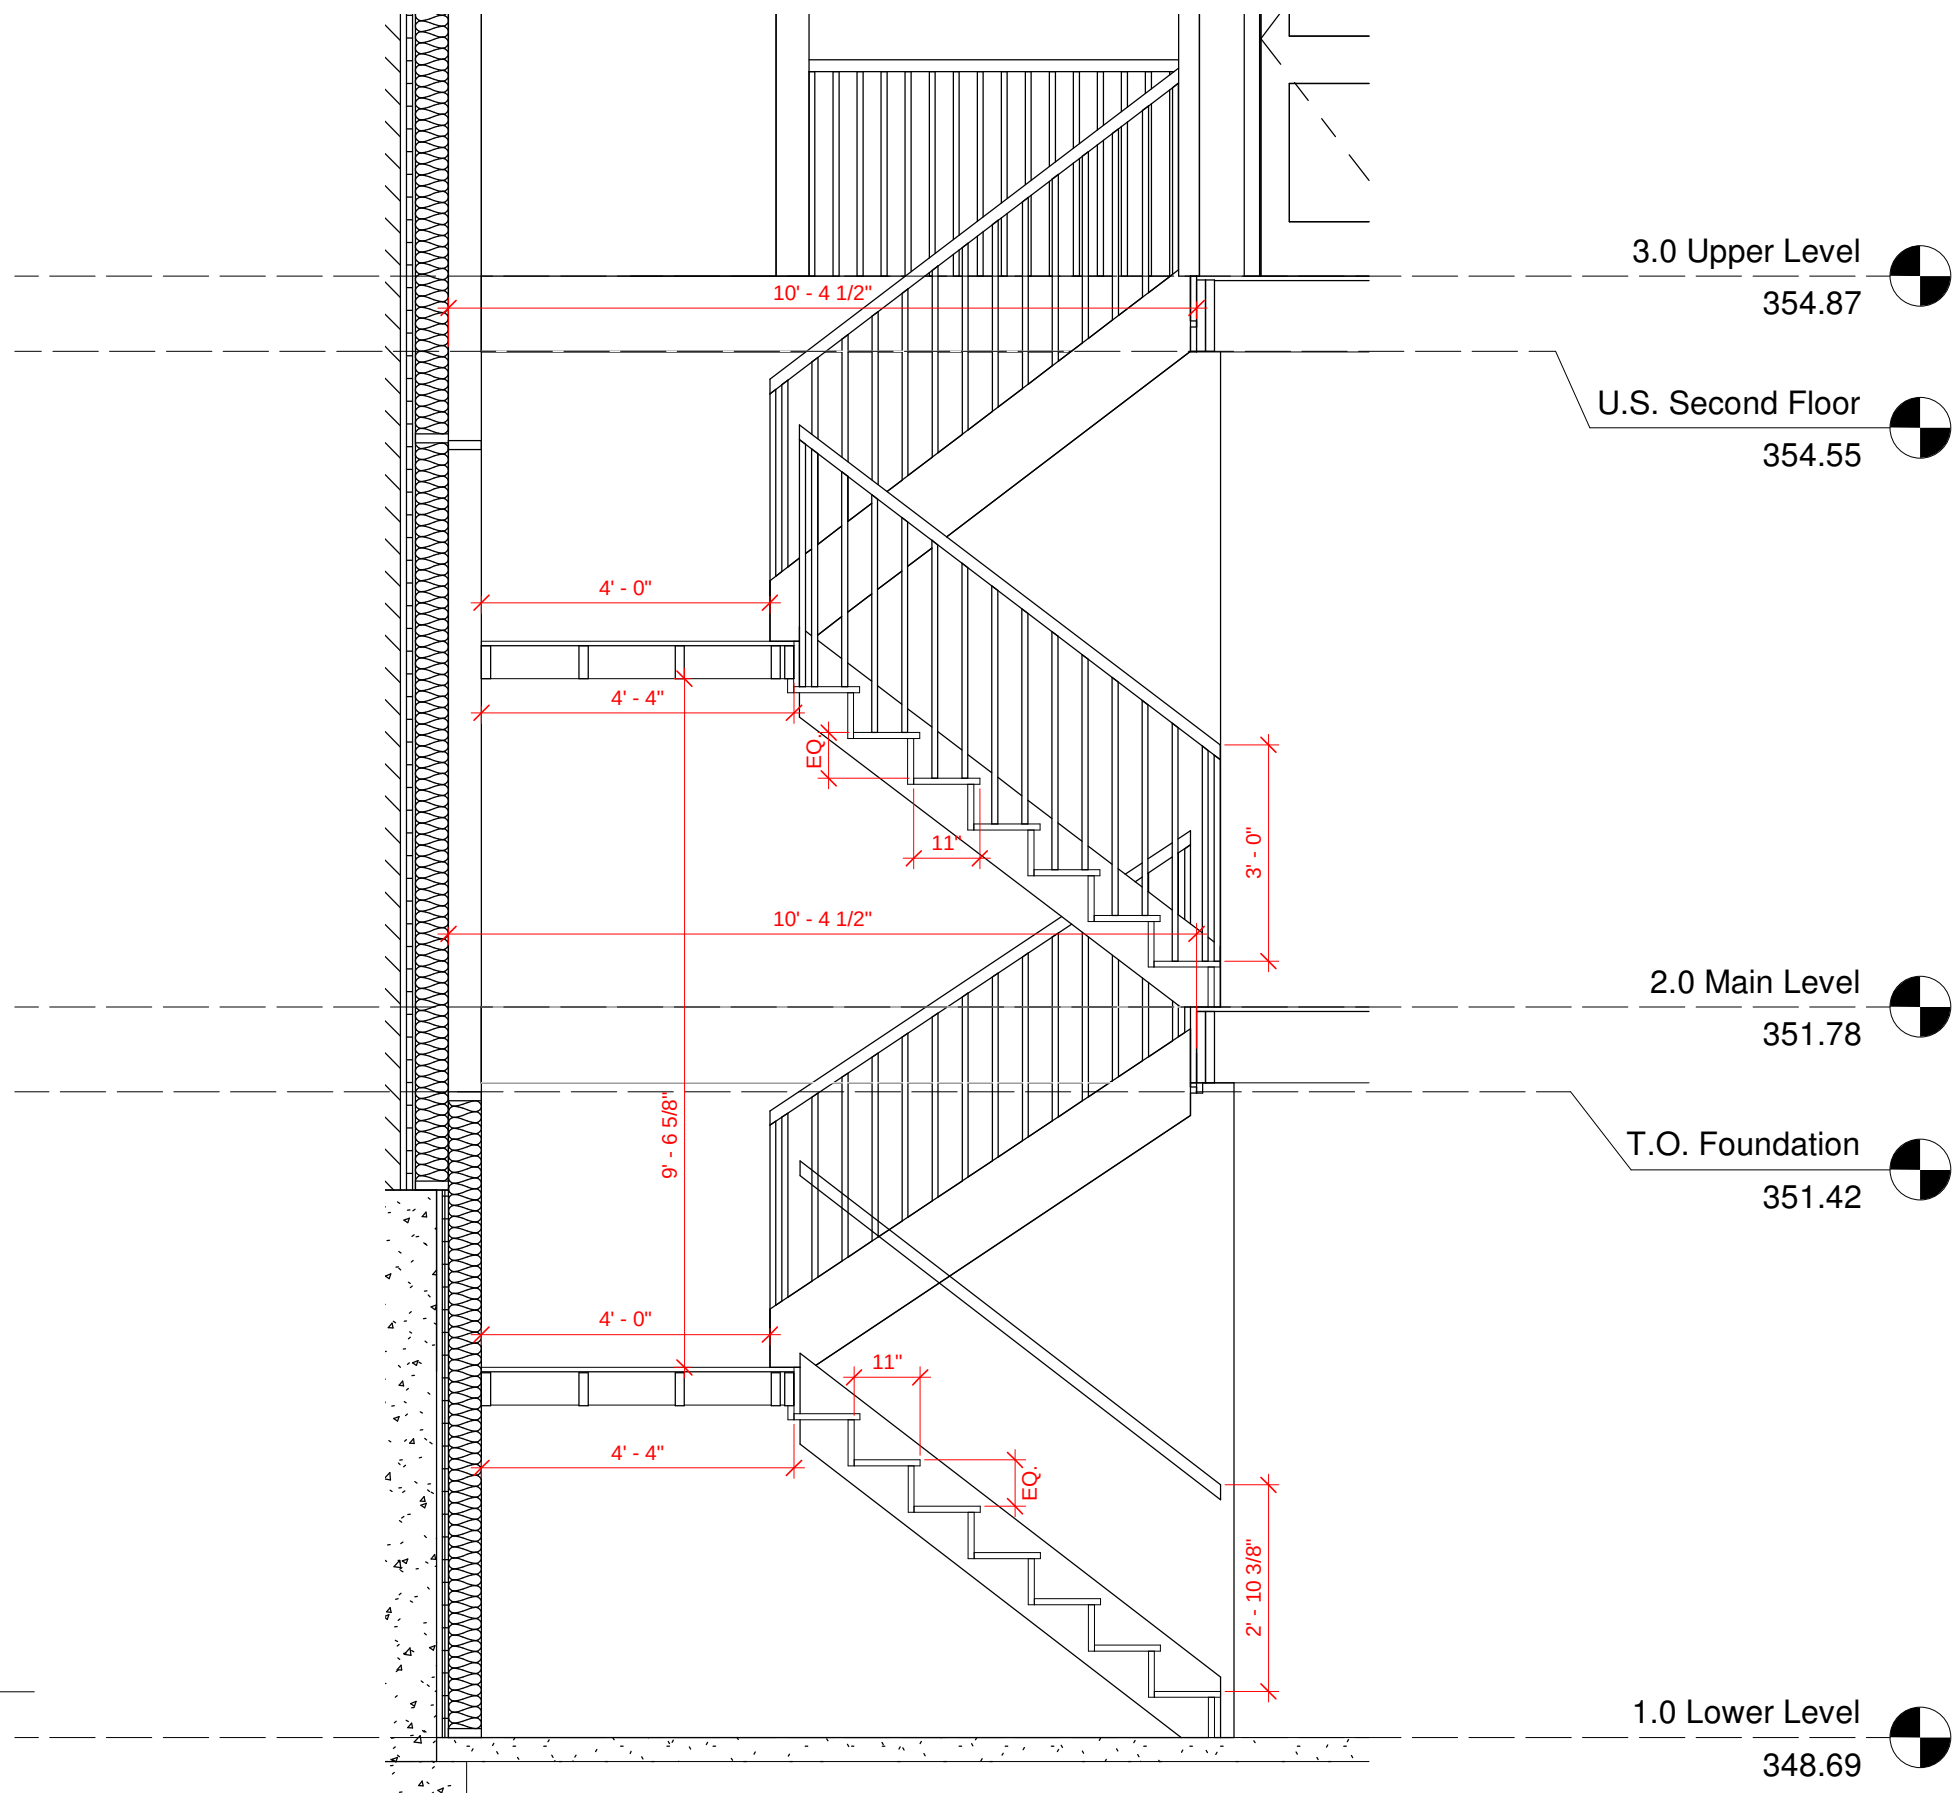

**1 Stair Section**  
 3/8" = 1'-0"





**GENERAL NOTES**

- UNLESS HIRED TO SUPERVISE, THE DESIGNER SHALL NOT BE HELD RESPONSIBLE FOR ERRORS MADE DURING CONSTRUCTION, DUE TO THE FAILURE OF THE FOLLOWING: THESE DRAWINGS, THE LATEST EDITION OF THE ONTARIO BUILDING CODE, AND GOOD BUILDING PRACTICES.
- ANY TRUSSES USED MUST BE DESIGNED BY A STRUCTURAL ENGINEER AND BEAR HIS SEAL. APPROVED PRE-ENG. TRUSSES & FLOOR DRAWINGS AND SPECIFICATIONS INCLUDING ALL LVL BEAMS ARE TO BE PROVIDED TO THE BUILDING INSPECTOR AT FRAMING INSPECTION.
- THE ONTARIO BUILDING CODE REQUIRES THAT A COPY OF THE DRAWINGS AND SPECIFICATIONS THAT HAVE BEEN REVIEWED BY THE BUILDING DEPARTMENT ARE TO BE KEPT AT THE CONSTRUCTION SITE AT ALL TIMES.
- CAULK AROUND ALL DOORS AND WINDOWS.
- ALL GRADING MUST BE POSITIVE AND AWAY FROM BUILDING.
- PROVIDE OUTSIDE AIR INTAKE FOR ALL SOLID FUEL BURNING FIREPLACES.
- ALL WORK MUST BE PERFORMED IN A PROFESSIONAL MANNER TRUE, PLUMB AND SQUARE
- ALL EXTERIOR MEASUREMENTS ARE TAKEN TO THE EXTERIOR OF THE FOUNDATION UNLESS NOTED OTHERWISE.
- ALL INTERIOR MEASUREMENTS FOR UNFINISHED AREAS ARE TAKEN TO FRAMING AND WHERE THE AREAS ARE FINISHED WITH DRYWALL THE DIMENSIONS ARE TAKEN TO THE FINISHED DRYWALL.

**SITE NOTES**

- NO PART OF THE CONSTRUCTION DURING THE ENTIRE PROCESS IS PERMITTED TO ENCROACH ONTO ADJACENT PROPERTY, WITHOUT OBTAINING, WRITTEN APPROVAL THROUGH A WRITTEN AGREEMENT BETWEEN THE AFFECTED PARTIES.
- A GEOTECHNICAL ENGINEER SHALL BE RETAINED BY THE OWNER FOR THE INSPECTION OF SOIL AND TO CONFIRM BEARING CAPACITY PRIOR TO THE PLACEMENT OF CONCRETE.
- ANY EXCAVATION THAT EXCEEDS 4' 0" IS REQUIRED TO BE SHORED OR CUT BACK AT THE TOP SO THAT THE ANGLE DOES NOT EXCEED 1:1. ENGINEERED DRAWINGS MUST BE SUBMITTED TO THE MUNICIPALITY FOR APPROVAL IF SHORING IS REQUIRED.
- EXCAVATION TO BE DONE IN A MANNER IN WHICH THE MOVEMENT OR DAMAGE OF ADJACENT STRUCTURES, PROPERTY, SERVICES, ROADS & SIDEWALKS IS AVOIDED DURING CONSTRUCTION.
- CONTRACTOR TO CALL FOR LOCATION OF ALL UNDERGROUND UTILITIES BEFORE THE COMMENCEMENT OF ANY WORK.
- AN ONTARIO LAND SURVEYOR MUST BE RETAINED TO CONFIRM THE GRADING SHOWN ON THE ELEVATIONS IS ACCURATE PRIOR TO CONSTRUCTION AND ANY DISCREPANCIES MUST BE REPORTED TO DESIGNER BEFORE PROCEEDING.

**PLAN NOTES**

- LATEST APPROVED DRAWINGS ONLY TO BE USED FOR CONSTRUCTION
- DRAWINGS AND SPECIFICATIONS ARE THE DESIGNER'S PROPERTY. ANY REPRODUCTION WITHOUT WRITTEN CONSENT IS STRICTLY PROHIBITED.
- DRAWINGS ARE NOT TO BE SCALED.
- THE BUILDER IS RESPONSIBLE TO CHECK AND VERIFY ALL DIMENSIONS ON SITE BEFORE PROCEEDING W/ CONSTRUCTION INCLUDING EXTERIOR LANDSCAPE. REPORT ANY DISCREPANCIES BETWEEN THE DRAWINGS AND THE SITE CONDITIONS TO THE DESIGNER/OWNER IMMEDIATELY.
- HANDWRITTEN NOTES ON THE DRAWINGS ABBREVIATED BY THE ENGINEER OR BUILDING OFFICIALS HAVE PRECEDENCE.
- CONTRACTOR SHALL COORDINATE AND OBTAIN ALL WRITTEN APPROVALS FROM AUTHORITIES BEFORE THE COMMENCEMENT OF ANY WORK.
- CONTRACTOR TO COORDINATE LOCATION OF ALL ELECTRICAL LAYOUTS WITH HOMEOWNER ON SITE. ALL ELECTRICAL ROUGH-IN AND FIXTURES MUST CONFORM TO AND BE INSTALLED ACCORDING TO THE ONTARIO BUILDING CODE AND CSA REQUIREMENTS.
- CONTRACTOR TO PROVIDE SOLID WOOD BLOCKING FOR SUSPENDED CABINETS. TO BE COORDINATED WITH THE MILLWORK SUBTRADE.
- THE ONTARIO BUILDING CODE REQUIRES THAT A SMOKE ALARM BE INSTALLED ON EACH FLOOR LEVEL AND WITHIN EACH SLEEPING ROOM. ALL SMOKE ALARMS SHALL BE INTERCONNECTED. EACH DEVICE SHALL HAVE A VISUAL SIGNALING COMPONENT IN ADDITION TO THE TEMPORAL PATTERN IN CONFORMANCE WITH 18.5.3 OF "LIGHT, COLOUR, AND PULSE CHARACTERISTICS" OF NFPA 72
- A CARBON MONOXIDE DETECTOR SHALL BE LOCATED ADJACENT TO SLEEPING AREAS.
- FOR WALKOUTS OR FOR FINISHED BASEMENTS, BOTH SUPPLY AND RETURN AIR DUCTS MUST BE AT FLOOR LEVEL.
- A LANDING IS REQUIRED AT THE ENTRANCE FROM AN ATTACHED GARAGE WHEN THERE ARE MORE THAN RISERS BETWEEN THE GARAGE FLOOR AND THE INTERIOR FLOOR LEVELS IN ACCORDANCE WITH 9.8.6.5.(3)(a). GUARDS CONFORMING TO OBC 9.8.8 & SB-7 ARE REQUIRED WHEN LANDING EXCEEDS 24" ABOVE GARAGE FLOOR.
- MAX. 3 RISERS TO OMIT LANDING AT THE TOP OF STAIRS.
- ALL WINDOW MEASUREMENTS ARE WINDOW FRAME SIZE, NOT RSO. ADD MIN. 1/2" PER SIDE FOR EACH WINDOW AND 1" PER SIDE ON EACH DOOR FOR RSO.

**MISC. NOTES**

- SUMP PUMP PIT SHALL BE INSTALLED AND CONNECTED TO THE STORM SEWER. CONTACT ENGINEERING SERVICES FOR VERIFICATION OF LOCATION.
- MANUFACTURED ITEMS AND MATERIALS MUST COMPLY WITH ALL REQUIREMENTS OF ULC, CSA OR ANY OTHER REGULATING BODIES AS PER APPLICABLE CODE.
- EXTERIOR STRUCTURAL WOOD ELEMENTS SHALL BE PRESSURE-TREATED FOR TERMITE AND DECAY PROTECTION WHERE VERTICAL CLEARANCE BETWEEN WOOD ELEMENTS AND THE FINISHED GROUND LEVEL IS LESS THAN 6".
- FOR ALL WOOD FRAMING MEMBERS THAT ARE IN CONTACT WITH CONCRETE THAT IS LESS THAN 6" ABOVE GRADE OR ON A CONCRETE SLAB, PROVIDE 6 MIL POLY OR SILL GASKET BETWEEN WOOD AND CONCRETE.
- TEMPERED GLASS TO BE USED FOR ALL SHOWER OR BATHTUB ENCLOSURES AND GUARDS.

- ROOF OR ATTIC SPACE ABOVE AN INSULATED CEILING SHALL BE VENTED WITH OPENINGS TO THE EXTERIOR HAVING A TOTAL UNOBSTRUCTED AREA NOT LESS THAN 1/300 OF THE INSULATED CEILING AREA (HALF TO BE LOCATED IN THE SOFFIT, THE OTHER HALF SHALL BE LOCATED AT OR NEAR THE RIDGE).
- FLASHING IS REQUIRED AT ALL INTERSECTIONS OF ROOF AND WALL AS WELL AS UNDER ALL SILLS AND OVERHEAD OF WINDOWS AND OR DOORS IN EXTERIOR WALLS.
- CHECK AND VERIFY ALL BEARING AND STRUCTURAL DISCREPANCIES AND REPORT TO DESIGNER IMMEDIATELY, PRIOR TO CONSTRUCTION OR BEFORE PROCEEDING.

**FRAMING NOTES**

- WOOD CONSTRUCTION SHALL CONFORM TO CSA STANDARD 068 AND TO THE ONTARIO BUILDING CODE.
- WHERE MULTIPLE TRUSSES ARE REQUIRED IN THE ROOF STRUCTURE (SUCH AS A GIRDER TRUSS), PROVIDE AN EQUAL AMOUNT OF WALL STUDS TO FORM A POST DIRECTLY BELOW DOWN TO FOUNDATION.
- LUMBER, UNLESS OTHERWISE NOTED, IS TO BE SPF SPECIES GRADE NO. 1 OR 2 CONFORMING TO CSA STANDARD 0141 W/ A MAX. MOISTURE CONTENT OF 15% AT THE TIME OF INSTALLATION. LUMBER SHALL BEAR THE GRADING STAMP OF AN AGENCY APPROVED BY THE CANADIAN LUMBER STANDARDS ADMINISTRATION BOARD.
- FLOOR JOISTS AND ROOF TRUSSES ARE SPECIFIED ON THE PLANS ACCORDING TO SIZE, SPACING AND SPAN. WHERE TRUSSES OR JOISTS ARE FLUSH FRAMED INTO THE SIDE OF A BEAM, PROVIDE APPROVED APPROPRIATELY SIZED FACE MOUNT HANGERS UNLESS NOTED OTHERWISE.
- PROVIDE DOUBLE JOISTS UNDER PARTITION WALLS PARALLEL TO JOISTS.
- PROVIDE BLOCKING OR BRIDGING IN ACCORDANCE WITH THE ONTARIO BUILDING CODE SPACING TO BE AT THE END AND AT 2100mm (7' 0") MAX. CENTERS, UNLESS THE JOIST SPAN IS WITHIN 450mm (1' 6") OF THE MAX. SPAN PERMITTED BY THE ONTARIO BUILDING CODE, IN WHICH CASE BLOCKING OR BRIDGING SHALL BE AT MAX. EVERY 1370mm (4' 3") O.C.
- NOTCHING AND DRILLING ONLY ALLOWED WITHIN THE LIMITATIONS SET OUT IN THE ONTARIO BUILDING CODE (9.23.5) OR APPROVED BY ENGINEERED WOOD PRODUCTS MANUFACTURER.
- CONTRACTOR SHALL ENSURE ALL CONSTRUCTION IS BRACED TEMPORARILY UNTIL ROOF AND FLOOR SHEATHING, AND ANY OTHER PERMANENT BRACING IS IN PLACE.
- ALL LUMBER AND TIMBER CONNECTIONS SHALL BE IN ACCORDANCE WITH THE ONTARIO BUILDING CODE AND WITH GOOD CARPENTRY PRACTICES.
- STUD WALLS TO BE SIZED AND SPACED AS NOTED ON THE DRAWINGS. UNLESS NOTED OTHERWISE, PROVIDE A MIN. OF 2 STUDS AT CORNERS, INTERSECTIONS AND EACH SIDE OF OPENINGS. ALL STUDS TO BE CONTINUOUS FOR THE FULL STOREY HEIGHT WITH NO SPLICING, BLOCKING REQUIRED AT 9' 10" FOR ALL STUD WALLS OVER 9' 10" TALL UNLESS NOTED OTHERWISE. PROVIDE DOUBLE TOP PLATE FOR LOAD BEARING WALLS. TOP PLATES TO BE LAPPED AT CORNERS AND INTERSECTIONS. NON-LOAD BEARING WALLS TO CONFORM TO THE REQUIREMENTS OF THE ONTARIO BUILDING CODE.
- NAILS, SPIKES AND STAPLES SHALL CONFORM TO CSA STANDARDS B111 AND BE GALVANIZED FOR EXTERIOR WORK OR IN HIGHLY HUMID AREAS AND IN TREATED LUMBER. PLAIN ELSEWHERE. UNLESS OTHERWISE NOTED, NAILING OF FRAMING SHALL CONFORM TO TABLES 9.23.3 A AND B OF THE ONTARIO BUILDING CODE.
- METAL CONNECTORS AND ROUGH HARDWARE, SUCH AS BOLTS, WASHERS, LAGS, AND SCREWS, TO BE HOT DIP GALVANIZED. ALL BOLTS SHALL BE A307 AND PROVIDE STANDARD WASHERS AT FACE OF WOOD SURFACE.
- WOOD PRESERVATIVE, WHERE REQUIRED, IS TO CONFORM TO CSA STANDARD 080. ALL EXTERIOR LUMBER EXPOSED TO WEATHER SHALL BE PRESSURE TREATED.
- FRAMING ANCHORS, JOIST HANGERS, BEAM HANGERS, POST CAPS, POST ANCHORS, AND ANGLES ARE ALL TO BE BY SIMPSON CONNECTORS OR AN APPROVED EQUAL, SIZED ACCORDING TO THEIR USE IN THIS PROJECT. ALL ARE TO BE INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS AND UTILIZING "SPECIAL" NAILS WHERE REQUIRED. ANGLES SHALL CONFORM TO G40.21 M300W.
- SHEATHING SHALL BE EXTERIOR TYPE PLYWOOD CONFORMING TO CSA 0121-M1978 "DOUGLAS FIR PLYWOOD" OR CSA 0151-M1978 "CANADIAN SOFTWOOD PLYWOOD". ALL SHEATHING TO BE TONGUE AND GROOVE WHERE POSSIBLE OR UTILIZE GALVANIZED H'CLIPS WHERE SHEATHING IS TOO THIN TO T&G.
- PLYWOOD SHEATHING SHALL BE INSTALLED WITH THE SURFACE GRAIN AT RIGHT ANGLES TO THE SHEATHING AND WITH THE END JOISTS STAGGARED. LAYOUT SHEATHING IN A STAGGERED PATTERN SUCH THAT EACH SHEET IS AT LEAST TWO SPAN CONTINUOUS WHEREVER POSSIBLE.
- ALL END JOINTS TO BE POSITIONED ALONG CENTER LINE OF SUPPORT BEHIND. SHEATHING SHALL BE INSTALLED WITH AT LEAST 3/32" GAP BETWEEN SHEETS.
- SHEATHING FASTENERS SHALL BE SPIRAL RING OR THREAD NAILS 2" MIN., UNLESS NOTED OTHERWISE.
- FRAMING NAILS TO BE MIN. 3 1/4" UNLESS OTHERWISE NOTED.
- SHEATHING SHALL BE NAILED TO SUPPORTS AT 6" O.C. ALONG EDGES AND 10" O.C. ALONG INTERMEDIATE SUPPORTS, UNLESS NOTED OTHERWISE.
- CEMENT SHALL BE PORTLAND CEMENT TYPE 10 UNLESS NOTED OTHERWISE. CONCRETE SHALL BE STONE CONCRETE WITH A UNIT WEIGHT OF 23.5 KN/M3.
- NO CALCIUM CHLORIDE, IN ANY FORM, IS PERMITTED IN ANY CONCRETE MIX.
- CURING AND PROTECTION OF CONCRETE FROM HOT, COLD, OR DRY WEATHER SHALL BE IN ACCORDANCE WITH CSA-A23.1.

**MAXIMUM ALLOWABLE BEARING PRESSURE**

|                                  |         |
|----------------------------------|---------|
| DENSE OR COMPACT SAND OR GRAVEL: | 150 kPa |
| LOOSE SAND OR GRAVEL:            | 50 kPa  |
| DENSE OR COMPACT SILT:           | 100 kPa |
| STIFF CLAY:                      | 150 kPa |
| FIRM CLAY:                       | 75 kPa  |
| SOFT CLAY:                       | 40 kPa  |
| TILL:                            | 200 kPa |
| CLAY SHALE:                      | 300 kPa |
| SOUND ROCK:                      | 500 kPa |

Drawings are only valid for permits after they have been signed. They are only valid for the original address in the titleblock. Do not scale drawings.

**Design Loads Criteria**

**Floor Loads:**  
 Live Load = 40 P.S.F.  
 Dead Load = 12 P.S.F.  
 Total Floor Load = 52 P.S.F.  
**Roof Loads:**  
 Live Loads = 42 P.S.F. (snowload)  
 Dead Load = 15 P.S.F.  
 Total Roof Load = 57 P.S.F.

**CLIENT NAME:**

**Crescent Homes**

Rockwood Block 1

**LOCATION:**

George St. E,  
 Guelph/Eramosa, ON



JANSSEN DESIGN

116063 2nd Line SW,  
 Melancthon, ON, L9V 2C5  
 Phone #: 519.925.0663  
 Fax #: 519.925.1371  
 Email: natasha@janssendesign.ca



THE GENERAL CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ALL ERRORS AND OMISSIONS TO THE DESIGNER BEFORE PROCEEDING WITH THE WORK.

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION  
 Paul Janssen BCIN 25681

REGISTRATION INFORMATION  
 Firm Name: Janssen Design & Construction  
 (Div. of JDC Custom Homes Inc.)  
 BCIN 32079

**DRAWING TITLE:**

**Construction Notes**

|                                 |                  |
|---------------------------------|------------------|
| <b>DATE:</b><br>JUNE 21, 2021   | <b>REVISIONS</b> |
| <b>DRAWN BY:</b><br>NJ          |                  |
| <b>CHECKED BY:</b><br>PJ        | <b>A113</b>      |
| <b>PROJECT NO:</b><br>1905-1023 |                  |